


FIRST FLOOR ELECTRICAL DEMOLITION PLAN
SCALE: 1/4"=1'-0"

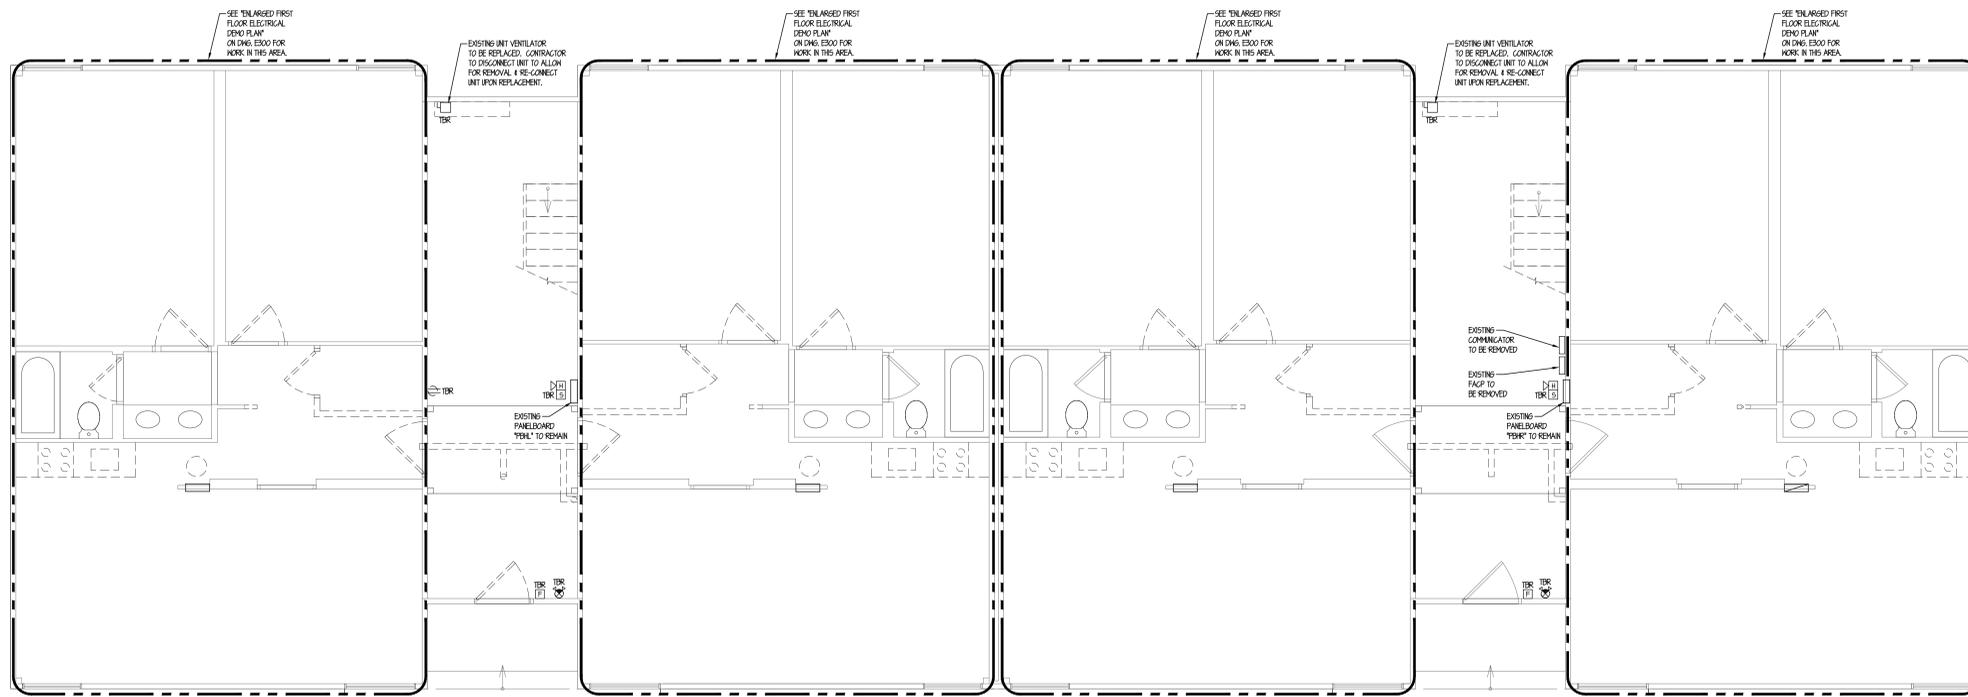

SECOND FLOOR ELECTRICAL DEMOLITION PLAN
SCALE: 1/4"=1'-0"

ELECTRICAL DEMOLITION NOTES:

- DO NOT CONSIDER DEMOLITION AND ABANDON NOTES TO BE ALL INCLUSIVE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO INSPECT AND ASSESS EACH SPACE, AND TO FULFILL THE INTENT OF THE WORK REQUIRED BY THE CONTRACT DOCUMENTS. VERIFY ALL DIMENSIONS WITHIN THE CONTRACT LIMITS. BRING DEVIATIONS FROM THE CONTRACT DOCUMENTS NECESSARY BY FIELD CONDITIONS TO THE ATTENTION OF THE ARCHITECT.
- CONTRACTOR SHALL DISCONNECT AND MAKE SAFE ALL AREAS PRIOR TO GENERAL DEMOLITION BY THE GENERAL CONTRACTOR. THIS SHALL INCLUDE ALL MECHANICAL EQUIPMENT, CONTROL SYSTEMS AND ACCESSORIES. ELECTRICAL CONTRACTOR SHALL REFER TO MECHANICAL DRAWINGS FOR MECHANICAL EQUIPMENT REMOVAL/DISCONNECT/DEMOLITION. CONTRACTOR TO PROVIDE TEMPORARY LIGHTING & POWER IN AREA OF WORK. TEMPORARY LIGHTING IS TO REMAIN AT COMPLETION OF PROJECT. TEMPORARY LIGHTING SHALL PROVIDE A MINIMUM OF 30 FOOT-CANDELES THROUGHOUT AREA OF WORK.
- TO ALL NECESSARY DEMOLITION AND REMOVAL OF EXISTING LIGHTING, EXISTING FIRE ALARM SYSTEM AND ELECTRICAL EQUIPMENT AS REQUIRED.
- DEMOLITION TO BE PERFORMED AFTER NORMAL WORKING HOURS IF REQUIRED BY THE OWNER.
- RESOLVE AND RECONNECT ALL CIRCUITS TO EXISTING LOADS WHICH ARE TO REMAIN IF SAME IS DISTURBED BY DEMOLITION WORK. PROVIDE NEW WIRE AS REQUIRED.
- CONDUITS COMING UP OUT OF FLOOR SLAB WHICH ARE TO BE REMOVED SHALL BE CUT BACK BELOW TOP OF FINISHED SLAB TO PREVENT DRIPPING.
- DISCONNECT AND REMOVE ALL EXISTING WIRING AND EXPOSED CONDUITS NOT BEING RETAINED OR REUSED.
- REMOVE ALL DEVICES AND ASSOCIATED WIRING AND CONDUITS FROM EXISTING OUTLETS, SWITCHES, FIRE ALARM DEVICES, ETC. BEING REMOVED TO PREVENT DRIPPING OVER THE ARCHITECTURAL SURFACE.
- WHERE EXISTING WIRING AND CIRCUITRY WHICH IS TO REMAIN IS LEFT EXPOSED BY DEMOLITION AND REMOVAL OF PARTITION AND/OR HANG CEILING, RESROUTE SUCH WIRING TO MAINTAIN THE GREATEST CONTINUITY.
- WHERE EXISTING LIGHTING EQUIPMENT, WIRING, ETC. IS INDICATED AS REWIRING AND SUCH ITEMS INTERFERE WITH THE INSTALLATION OF THE DEMOLITION WORK, OF COVER BRACES, DISCONNECT, REMOVE, AND RELOCATE TO AVOID CONFLICTS. REWIRING AND RECONNECT SUCH ITEMS AS REQUIRED.
- WHERE EXISTING LIGHTING FIXTURES AND DEVICES ARE BEING REMOVED AND SUCH REMOVAL DISTURBS THE CIRCUITRY TO LIGHTING FIXTURES AND DEVICES WHICH ARE TO REMAIN, PROVIDE ALL NECESSARY MODIFICATIONS AND ADDITIONS TO WIRING AS REQUIRED TO RETAIN SERVICE AND SWITCH CONTROL.
- RELOCATE EXISTING ACTIVE OUTLET BOXES, JUNCTION BOXES, ETC. WHICH ARE RENDERED INACCESSIBLE BY NEW CONSTRUCTION.
- ALL EXISTING BRANCHED CIRCUIT WIRING FROM RESIDENTIAL TRANSIT PANELS SHALL BE REMOVED.

Revisions

Date	Issue	Description
03-06-15	1	ISSUED FOR DCA FILING
03-18-15	2	ISSUED FOR BIDDING

Consultants

LINWOOD ENGINEERING ASSOCIATES, P.A.

CONSULTING MECHANICAL & ELECTRICAL ENGINEERS

LEA 955 Lincoln Ave. 2301 Dupont Drive-Suite 150
Glen Rock, New Jersey Irvine, California
07452 92512
t: 201.857.3998 t: 714.424.0001
f: 201.857.3994 f: 714.424.0004
www.linwoodengineering.com

Michael T. Davina, P.E. NJ #48654 CT #0025779	Robert J. Hatch, P.E. AR #13868 CA #E16118 CT #15318 FL #69560 MA #48516 NJ #30419 NY #019975 PA #56608 PA #036014-E
--	--

Project

INTERIOR RENOVATIONS
AT THE
HOLLY - C RESIDENCE
RAMAPO COLLEGE
OF NEW JERSEY
505 Ramapo Valley Road
Mahwah, New Jersey 07430-1680

Client

RAMAPO COLLEGE
OF NEW JERSEY
505 Ramapo Valley Road
Mahwah, New Jersey 07430-1680

SNS Architects & Engineers, PC
1 PARAGON DRIVE . MONTVALE . NEW JERSEY . 07645
tel: 201.573.1767 fax: 201.573.0808 www.sns-arch-eng.com

- Fay W. Logan, AIA
- John M. Lignos, AIA
- Lorin J. Somenshine, AIA
- Steven Napolitano, PE

Cert./Lic. No.	
Date	02-03-15 Scale AS NOTED
Drawn By	HD Checked By gg
Dwg. Title	FIRST & SECOND FLOOR ELECTRICAL DEMOLITION PLANS

Work Order No. **4698C** Dwg. No. **E100**