


NOTE:
ALL FIRE PROTECTION SYSTEM DEVICES
AND PIPING SHOWN ARE DIAGRAMMATICAL
AND ARE FOR REFERENCE ONLY.
CONTRACTOR IS RESPONSIBLE TO FIELD
VERIFY EXISTING CONDITIONS, INCLUDING
BUT NOT LIMITED TO, NUMBER OF
SPRINKLER HEADS, PIPE SIZES, DEVICE
LOCATIONS AND ASSOCIATED CONTROLS.
CONTRACTOR SHALL DESIGN AND INSTALL
A NEW FIRE PROTECTION SYSTEM AS PER
REQUIREMENTS OF NFPA 13 AND
AUTHORITY HAVING JURISDICTION FOR THIS
TYPE OF BUILDING CLASSIFICATION (R-2).
CONTRACTOR SHALL FRESHEN WATER,
FLOW TESTS, PROVIDE SIGNED AND
SEALED HYDRAULIC CALCULATIONS AND
FIRE PROTECTION PLANS, ALONG WITH
FIRE PROTECTION EQUIPMENT SHOP
DRAWINGS, TO THE ARCHITECT/ENGINEER
FOR REVIEW AND SUBMISSION TO NJ DCA.

CRAWL SPACE FIRE PROTECTION PLAN
SCALE: 1/4"=1'-0"

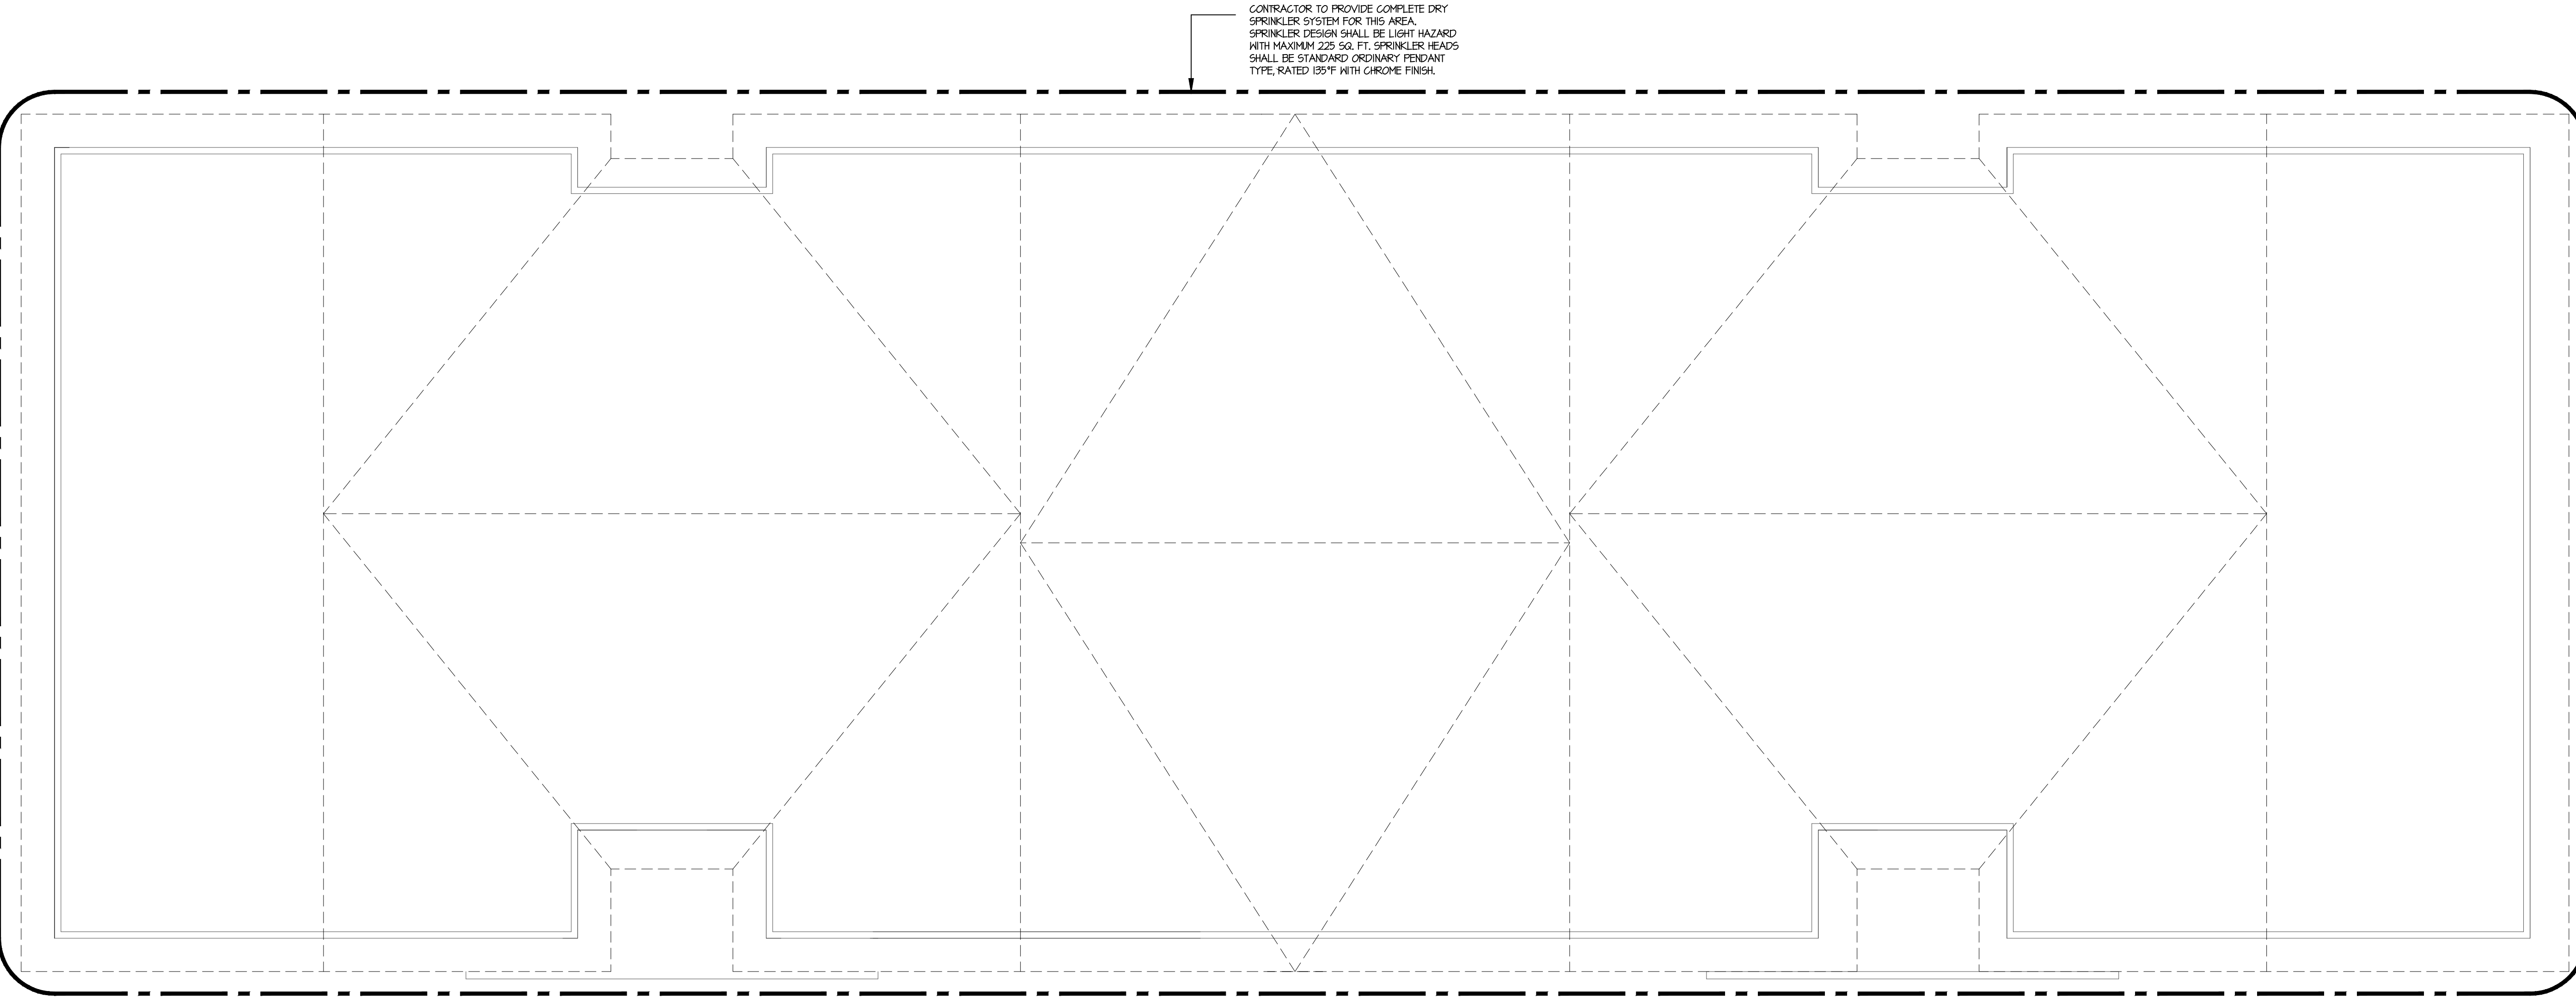

ATTIC FIRE PROTECTION PLAN
SCALE: 1/4"=1'-0"


Revisions

Date	Issue	Description
03-06-15	1	ISSUED FOR DCA FILING
03-18-15	2	ISSUED FOR BIDDING

Consultants

LINWOOD ENGINEERING ASSOCIATES, P.A.

CONSULTING MECHANICAL & ELECTRICAL ENGINEERS



955 Lincoln Ave.
Glen Rock, New Jersey 07452
t: 201.857.3998
f: 201.857.3994

2301 Dupont Drive-Suite 150
Irvine, California 92612
t: 714.424.0001
f: 714.424.0004

www.linwoodengineering.com

Michael T. Davina, P.E.

NJ #48654
CT #0025779

Robert J. Hatch, P.E.

AR #13868
CA #E16118
CT #13318
FL #69560
MA #48516
NJ #30419
NV #019975
NY #56608
PA #036014-E

Project

INTERIOR RENOVATIONS
AT THE
HOLLY- C RESIDENCE



RAMAPO COLLEGE
OF NEW JERSEY
505 Ramapo Valley Road
Mahwah, New Jersey 07430-1680

Client




RAMAPO COLLEGE
OF NEW JERSEY
505 Ramapo Valley Road
Mahwah, New Jersey 07430-1680



Architects & Engineers, PC

1 PARAGON DRIVE . MONTVALE . NEW JERSEY . 07645
tel: 201.573.1767 fax: 201.573.0808 www.sns-arch-eng.com

- Fay W. Logan, AIA ☐
- John M. Lignos, AIA ☐
- Lorin J. Sonenshine, AIA ☐
- Steven Napolitano, PE ☐



Cert./Lic. No.	Date	02-03-15	Scale	AS NOTED
Drawn By	HD	Checked By	sg	

Dwg. Title
**CRAWL SPACE & ATTIC
FIRE PROTECTION PLANS**

Work Order No. **4698C** Dwg. No. **FP100**