


NOTE:
ALL FIRE PROTECTION SYSTEM DEVICES AND PIPING SHOWN ARE DIAGRAMMATICAL AND ARE FOR REFERENCE ONLY. CONTRACTOR IS RESPONSIBLE TO FIELD VERIFY EXISTING CONDITIONS, INCLUDING BY NOT LIMITED TO NUMBER OF SPRINKLER HEADS, PIPE SIZES, DEVICE LOCATIONS AND ASSOCIATED CONTROLS. CONTRACTOR SHALL DESIGN AND INSTALL A NEW FIRE PROTECTION SYSTEM AS PER REQUIREMENTS OF NFPA 13 AND AUTHORITY HAVING JURISDICTION FOR THIS TYPE OF BUILDING CLASSIFICATION (R-2). CONTRACTOR SHALL PERFORM WATER FLOW TESTS, PROVIDE SIGNED AND SEALED HYDRAULIC CALCULATIONS AND FIRE PROTECTION PLANS, ALONG WITH FIRE PROTECTION EQUIPMENT SHOP DRAWINGS, TO THE ARCHITECT/ENGINEER FOR REVIEW AND SUBMISSION TO NJ DCA.


CRAWL SPACE FIRE PROTECTION PLAN

SCALE: 1/8"=1'-0"

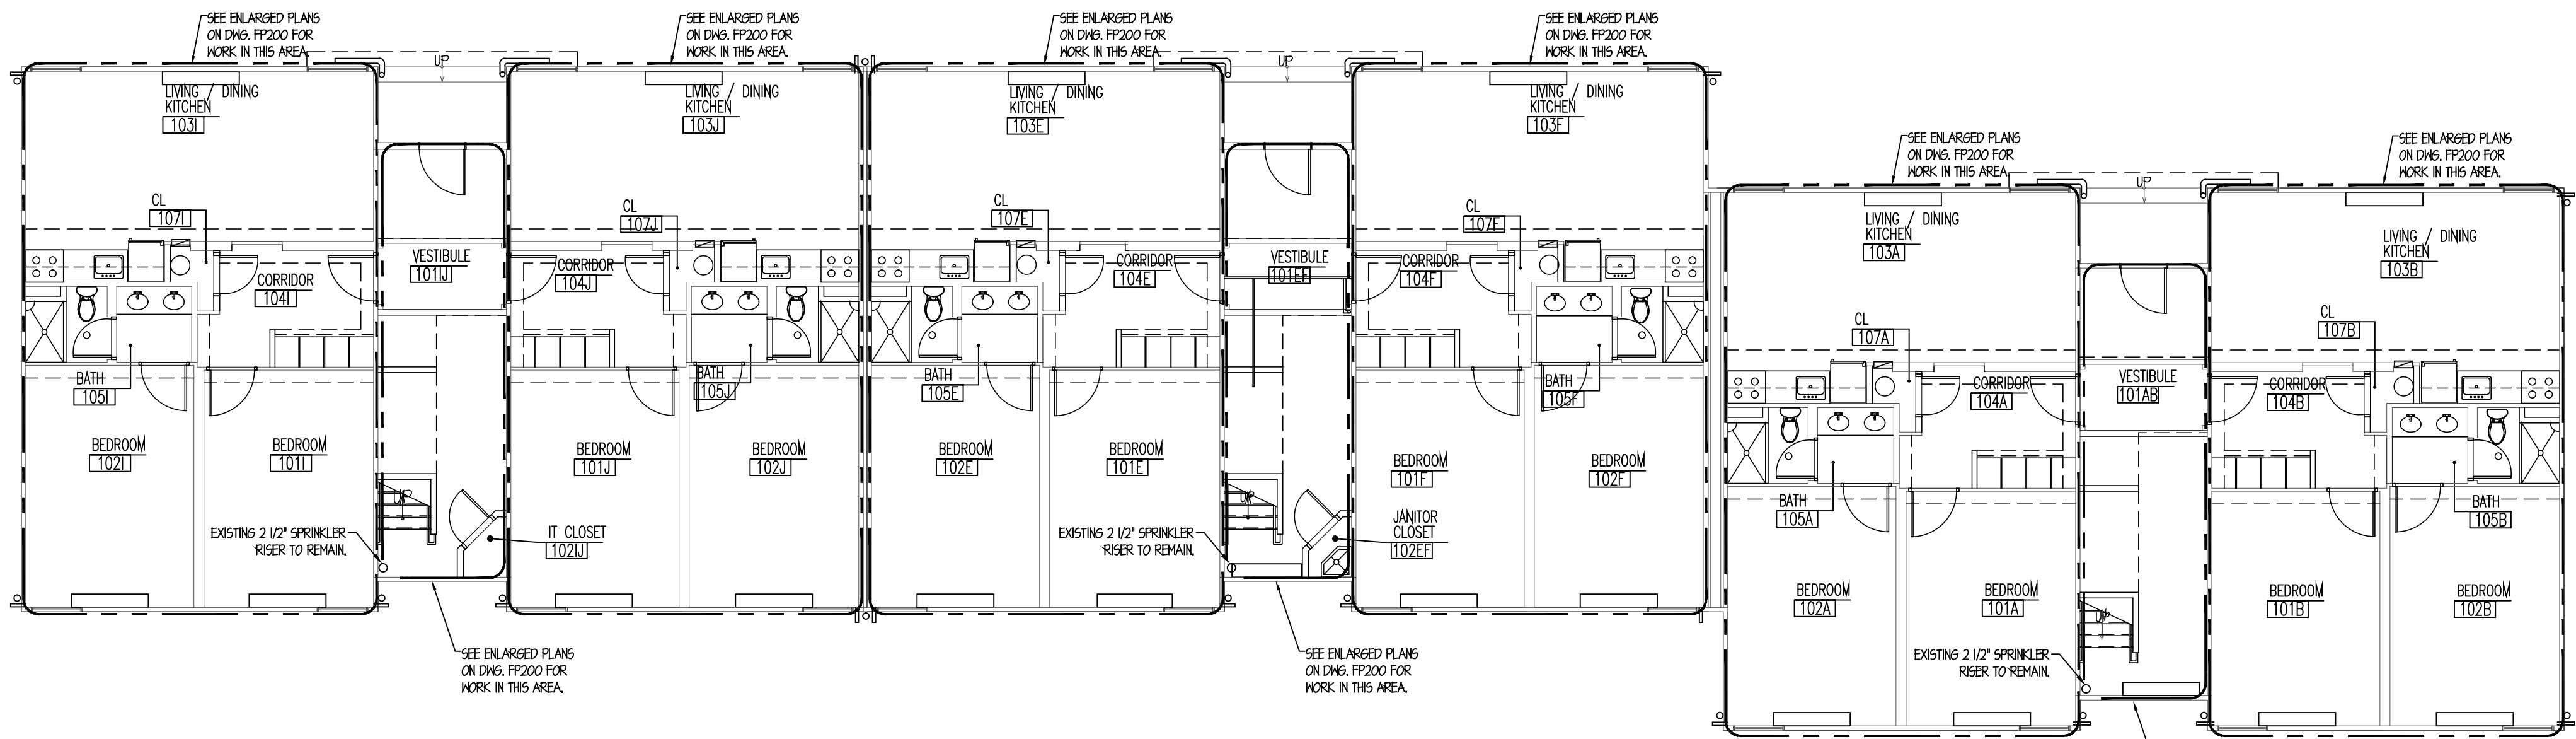

FIRST FLOOR FIRE PROTECTION PLAN

SCALE: 1/8"=1'-0"

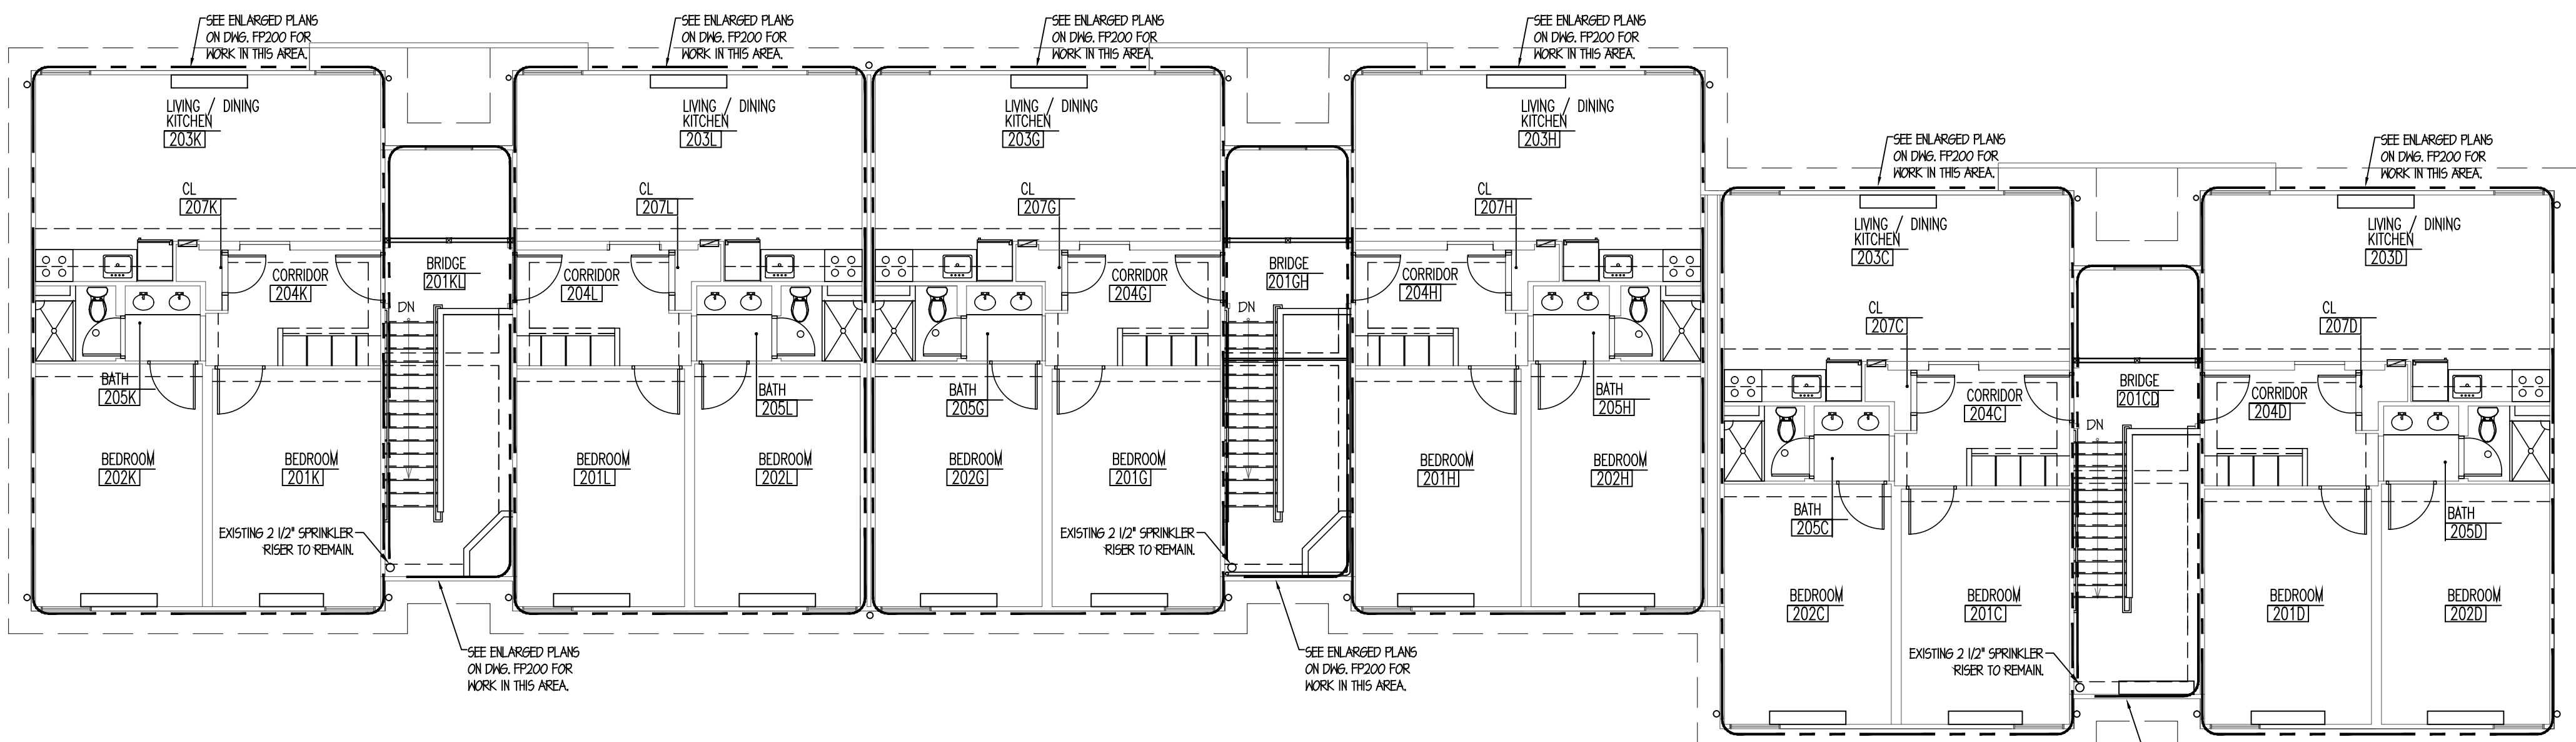

SECOND FLOOR FIRE PROTECTION PLAN

SCALE: 1/8"=1'-0"

Revisions

Date	Issue	Description
03-06-15	1	ISSUED FOR DCA FILING
03-18-15	2	ISSUED FOR BIDDING

Consultants

LINWOOD ENGINEERING ASSOCIATES, P.A.

CONSULTING MECHANICAL & ELECTRICAL ENGINEERS

LEA 955 Lincoln Ave. 2301 Dupont Drive-Suite 150
Glen Rock, New Jersey Irvine, California
07452 92512
t: 201.857.3998 f: 714.424.0001
t: 201.857.3994 f: 714.424.0004
www.linwoodengineering.com

Michael T. Davina, P.E. **Robert J. Hatch, P.E.**

NJ #48654
CT #0025779
AR #13868
CA #E16118
CT #15318
FL #69560
MA #48516
NJ #30419
NV #019975
NY #56608
PA #036014-E

Project

INTERIOR RENOVATIONS
AT THE
MIMOSA - G RESIDENCE

RAMAPO COLLEGE
OF NEW JERSEY
505 Ramapo Valley Road
Mahwah, New Jersey 07430-1680

Client

RAMAPO COLLEGE
OF NEW JERSEY
505 Ramapo Valley Road
Mahwah, New Jersey 07430-1680

SNS Architects & Engineers, PC
1 PARAGON DRIVE . MONTVALE . NEW JERSEY . 07645
tel: 201.573.1767 fax: 201.573.0808 www.sns-arch-eng.com

Fay W. Logan, AIA
John M. Lignos, AIA
Lorin J. Sonenshine, AIA
Steven Napolitano, PE

Cert./Lic. No.
Date 02-03-15 Scale AS NOTED
Drawn By PSC/ADD Checked By MD
Dwg. Title
**CRAWL SPACE, FIRST & SECOND FLOOR
FIRE PROTECTION PLANS**

Work Order No. Dwg. No.

4698G **FP100**