


- ELECTRICAL DEMOLITION NOTES:**
- DO NOT CONSIDER DEMOLITION AND ALTERATION NOTES TO BE ALL INCLUSIVE. IT IS THE CONTRACTORS' RESPONSIBILITY TO INSPECT AND ASSESS EACH SPACE, AND TO FILL THE INTERIOR OF THE WORK INDICATED BY THE CONTRACT DOCUMENTS. VERIFY ALL DIMENSIONS WITHIN THE CONTRACT LIMITS. BRING DEVIATIONS FROM THE CONTRACT DOCUMENTS NOTICED BY FIELD CONDITIONS TO THE ATTENTION OF THE ARCHITECT.
 - CONTRACTOR SHALL DISCONNECT AND MAKE SAFE ALL AREAS PRIOR TO GENERAL DEMOLITION BY THE GENERAL CONTRACTOR. THIS SHALL INCLUDE ALL MECHANICAL EQUIPMENT, CONTROL SYSTEMS AND ACCESSORIES. ELECTRICAL CONTRACTOR SHALL REFER TO MECHANICAL DRAWINGS FOR MECHANICAL EQUIPMENT REMOVAL DISCONNECT/DEMOLITION. CONTRACTOR TO PROVIDE TEMPORARY LIGHTING & POWER IN AREA OF WORK. TEMPORARY LIGHTING IS TO REMAIN AT COMPLETION OF PROJECT. TEMPORARY LIGHTING SHALL PROVIDE A MINIMUM OF 30 FOOTCANDLES THROUGHOUT AREA OF WORK.
 - DO ALL NECESSARY DEMOLITION AND REMOVAL OF EXISTING LIGHTING EXISTING FIRE ALARM SYSTEM AND ELECTRICAL EQUIPMENT AS REQUIRED.
 - DEMOLITION TO BE PERFORMED AFTER NORMAL WORKING HOURS IF REQUIRED BY THE OWNER.
 - REROUTE AND RECONNECT ALL CIRCUITS TO EXISTING LOADS WHICH ARE TO REMAIN IF SAME IS DISTURBED BY DEMOLITION WORK. PROVIDE NEW HOME RUNS, IF REQUIRED.
 - CONDUITS COMING UP OUT OF FLOOR SLABS WHICH ARE TO BE REMOVED SHALL BE CUT BACK BELOW TOP OF FINISHED SLAB TO PERMIT PATCHING.
 - DISCONNECT AND REMOVE ALL EXISTING WIRING AND EXPOSED CONDUITS NOT BEING RETAINED OR REUSED.
 - REMOVE ALL DEVICES AND ASSOCIATED WIRING AND CONDUITS FROM EXISTING OUTLETS, SWITCHES, FIRE ALARM DEVICES, ETC. BEING REMOVED TO PERMIT PATCHING OVER THE ARCHITECTURAL SURFACE.
 - WHERE EXISTING WIRING AND CIRCUITRY WHICH IS TO REMAIN IS LEFT EXPOSED BY DEMOLITION AND REMOVAL OF PARTITION AND/OR FINISH CEILING, REROUTE SUCH WIRING TO MAINTAIN THE CIRCUIT CONTINUITY.
 - WHERE EXISTING LIGHTING EQUIPMENT, WIRING, ETC. IS INDICATED AS REMAINING AND SUCH ITEMS INTERFERE WITH THE INSTALLATION OR THE DEMOLITION WORK OF OTHER TRADES, DISCONNECT, REMOVE, AND RELOCATE TO AVOID CONFLICTS. REROUTE AND RECONNECT SUCH ITEMS AS REQUIRED.
 - WHERE EXISTING LIGHTING FIXTURES AND DEVICES ARE BEING REMOVED AND SUCH REMOVAL DISTURBS THE CIRCUITRY TO LIGHTING FIXTURES AND DEVICES WHICH ARE TO REMAIN, PROVIDE ALL NECESSARY MODIFICATIONS AND ADJUSTIONS TO WIRING AS REQUIRED TO RETAIN SERVICE AND SWITCH CONTROL.
 - RELOCATE EXISTING ACTIVE OUTLET BOXES, JUNCTION BOXES, ETC. WHICH ARE RENDERED INACCESSIBLE BY NEW CONSTRUCTION.
 - ALL EXISTING BRANCH CIRCUIT WIRING FROM RESIDENTIAL TENANT PANELS SHALL BE REMOVED.

THIRD FLOOR ELECTRICAL DEMOLITION PLAN
SCALE: 1/4"=1'-0"

Revisions

Date	Issue	Description
06-03-15	1	ISSUED FOR CONSTRUCTION
11-16-15	2	REVISED PER NJDOCA ELECTRONIC STAMP

Key Plan

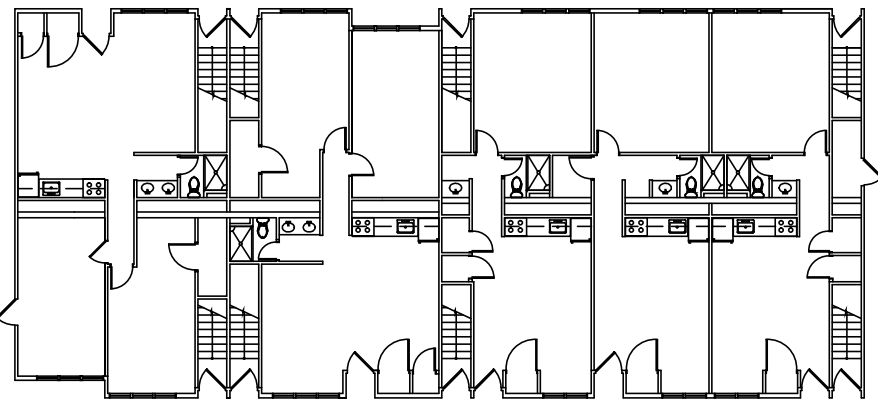

Consultants

LINWOOD ENGINEERING ASSOCIATES, P.A.

CONSULTING MECHANICAL & ELECTRICAL ENGINEERS

LEA

955 Lincoln Ave.
Glen Rock, New Jersey
07452
t: 201.857.3998
f: 201.857.3984

2301 Dupont Drive-Suite 150
Irvine, California
92612
t: 714.424.0001
f: 714.424.0004
www.linwoodengineering.com


Project

INTERIOR RENOVATIONS
AT THE
BUTTERNUT - M RESIDENCE



RAMAPO COLLEGE
OF NEW JERSEY
505 Ramapo Valley Road
Mahwah, New Jersey 07430-1680

Client



RAMAPO COLLEGE
OF NEW JERSEY
505 Ramapo Valley Road
Mahwah, New Jersey 07430-1680


SNS

Architects & Engineers, PC

1 PARAGON DRIVE . MONTVALE . NEW JERSEY . 07645
tel: 201.573.1767 fax: 201.573.0808 www.sns-arch-eng.com

Fay W. Logan, AIA
John M. Lignos, AIA
Lorin J. Sonenshine, AIA
Steven Napolitano, PE

☐
☐
☐
☐



Michael T. Davina, P.E.
NJ #48654
CT #0025779

Robert J. Hatch, P.E.
AR #13868
CA #E16118
CT #15318
FL #69560
MA #48516
NJ #35419
NV #019975
NY #56608
PA #036014-E

Cert./Lic. No.
Date 04-23-15 Scale AS NOTED
Drawn By KEB/Cadd Checked By MD
Dwg. Title
THIRD FLOOR ELECTRICAL DEMOLITION PLAN
Work Order No. Dwg. No.
4698M E101