

PLUMBING NOTES AND SPECIFICATIONS

GENERAL

- CONTRACTOR SHALL PERFORM ALL WORK SO AS TO CONFORM TO LOCAL, STATE AND NATIONAL CODES AND THE REQUIREMENTS OF LOCAL AUTHORITIES HAVING JURISDICTION.
- CONTRACTOR SHALL EXAMINE SITE TO DETERMINE THE EXACT CONDITIONS EFFECTING THE PLUMBING WORK.
- DRAWINGS INDICATE THE GENERAL SCHEME OF THE INSTALLATION AND ARE DIAGRAMMATIC IN SCOPE. THE ENGINEER RESERVES THE RIGHT TO CHANGE THE LOCATION OF PIPING, FIXTURES, ETC. TO A REASONABLE EXTENT AS THE BUILDING CONDITIONS MAY DICTATE. PRIOR TO THEIR INSTALLATION WITHOUT EXTRA COST TO THE OWNER, THE EXACT LOCATION AND ARRANGEMENT OF ALL EQUIPMENT AND PARTS SHALL BE DETERMINED AS THE WORK PROGRESSES.
- DETAILS OF CONSTRUCTION AND OF WORKMANSHIP WHERE NOT SPECIFICALLY DESCRIBED HEREON OR INDICATED ON THE DRAWINGS SHALL BE SUBJECT TO THE ENGINEER'S APPROVAL. IT IS THE INTENT OF THESE SPECIFICATIONS TO PROVIDE COMPLETE SYSTEMS, LEFT IN GOOD WORKING ORDER, READY FOR OPERATION.
- SCRAP AND DEBRIS, EXCEPT AS OTHERWISE SPECIFIED, SHALL BE REMOVED FROM THE SITE AND DISPOSED OF BY THIS CONTRACTOR.
- CONTRACTOR SHALL BE RESPONSIBLE FOR TESTING AND START-UP OF THE SYSTEM.
- ALL WORK SHALL BE DONE WITH A MINIMUM OF DUST AND DIRT. PROVIDE SUFFICIENT FIREPROOF TARPULINGS AND COVER ALL EQUIPMENT IN WORK AREA WITH SAME DURING INSTALLATION.
- CONTRACTOR SHALL FINISH SHOP DRAWINGS AND EQUIPMENT CUTS TO ARCHITECT FOR APPROVAL (MINIMUM FIVE (5) COPIES).
- CONTRACTOR SHALL FILE, SECURE AND PAY FOR ALL NECESSARY APPROVALS, PERMITS AND INSPECTIONS.
- ALL WORK SHALL BE GUARANTEED TO BE FREE FROM DEFECT FOR ONE YEAR AFTER ACCEPTANCE OF THE INSTALLATION BY OWNER.
- ALL WORK SHALL BE IN ACCORDANCE WITH THE NEW JERSEY UNIFORM CONSTRUCTION CODE AND THE NATIONAL STANDARD PLUMBING CODE.
- THE PLUMBING SYSTEM SHALL BE TESTED IN ACCORDANCE WITH THE NATIONAL STANDARD PLUMBING CODE. CONTRACTOR TO COORDINATE TESTS WITH LOCAL OFFICIALS.
- WHERE DEVICES REQUIRING ACCESS (VALVES, CLEANOUTS, ETC.) WOULD OTHERWISE BE RENDERED INACCESSIBLE BY BUILDING CONSTRUCTION, PROVIDE FRAMED ACCESS DOOR. ACCESS DOORS FINISHED SHALL BE COORDINATED WITH ARCHITECT. IN GENERAL, ACCESS DOORS SHALL BE PRIMED, PAINTABLE STEEL WHEN LOCATED IN OUTWALL CONSTRUCTION. ACCESS DOORS IN TOILET ROOM TILE WAINSCOT SHALL BE STAINLESS STEEL. ACCESS DOORS IN EXTERIOR WALLS SHALL BE PROVIDED WITH INSULATED DOORS. ACCESS DOORS IN COLUMN ENCLOSURES OR FIRE RESISTIVE WALLS SHALL BE FIRE RATED IN ACCORDANCE WITH BOCA ARTICLE 401.
- COORDINATE LOCATIONS OF ALL VALVES AND CONNECTIONS TO APPLIANCES WITH EQUIPMENT SUPPLIER.

SCOPE OF WORK

- THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE FURNISHING AND INSTALLATION OF ALL FIXTURES, MATERIALS, PIPING AND COMPONENTS AS REQUIRED FOR A COMPLETE AND OPERATIONALLY FUNCTIONAL SYSTEM. SCOPE OF WORK SHALL INCLUDE BUT NOT BE LIMITED TO:
- INSTALLATION OF ABOVE GROUND SANITARY DRAIN WASTE AND VENT PIPING.
 - INSTALLATION OF CLEANOUTS IN SANITARY DRAINAGE SYSTEMS.
 - INSTALLATION OF FLOOR DRAINS AS INDICATED ON THE DRAWINGS.
 - INSTALLATION OF DOMESTIC HOT AND COLD WATER PIPING INCLUDING ANTI-WATER HAMMER SHOCK ABSORBERS, VALVES, STOP VALVES, FLEX-SUPPLIES, DIELECTRIC UNIONS BETWEEN DISSIMILAR PIPING MATERIALS, ETC.
 - INSTALLATION OF DOMESTIC WATER HEATERS INCLUDING ASME APPROVED, ASA RATED TEMPERATURE AND PRESSURE RELIEF VALVES, GATE VALVES, UNIONS, REGULATION PUMPS, CHECK VALVES, CONTROLS, ETC.
 - INSTALLATION OF BACKFLOW PREVENTORS, PRESSURE REDUCING AND RELIEF VALVES AS INDICATED ON THE DRAWINGS.
 - INSTALLATION OF FIXTURES INCLUDING WALL HANGERS, SUPPORTS, STOP VALVES, FLEX-SUPPLIES, DRAIN TRAPS, STRAINERS, FAUCETS, SOAP DISPENSERS, OUTLET GUARDING SEATS AND OTHER DEVICES AS SHOWN ON THE DRAWINGS AND INDICATED IN THE SCHEDULE OF PLUMBING FIXTURES.
 - TESTING OF THE PLUMBING SYSTEM INCLUDING AIR OR WATER TEST OF DRAINAGE SYSTEM ROUGHINS, SMOKE TEST OF FINISHED DRAINAGE SYSTEM AND PRESSURE TEST OF DOMESTIC WATER SYSTEMS.
 - DISINFECTION OF THE DOMESTIC WATER SUPPLY SYSTEM.
 - PIPING SUPPORT INCLUDING SEISMIC RESTRAINT SHAY BRACING IN ACCORDANCE WITH INTERNATIONAL BUILDING CODE.
 - INSTALLATION OF FIBERGLASS INSULATION FITTING COVERS AND JACKETS ON ALL HOT AND COLD DOMESTIC WATER PIPES.
 - CUTTING AND PATCHING AS REQUIRED.
 - PERMITS, INSPECTIONS, APPROVALS AND CERTIFICATES, INCLUDING FEES.
 - GUARANTEE.

SANITARY DRAINAGE

- ABOVE GROUND SANITARY WASTE AND VENT DRAIN PIPING SHALL BE CAST IRON, 12-HUB TYPE.
- VERTICAL, NON-COMBUSTIBLE OCCUPYING AN AREA OF MORE THAN ONE SQUARE FOOT, PIPING ARRANGED IN GROUPS OF TWO OR MORE LINES, WHICH PENETRATE TWO OR MORE FLOORS, SHALL BE ENCLOSED IN SHAFT HAVING A FIRE RESISTANCE RATING IN ACCORDANCE WITH BOCA ARTICLE 401 (MINIMUM 1 HOUR).
- CLEANOUTS FOR SANITARY DRAINAGE SYSTEMS SHALL BE LOCATED IN ACCORDANCE WITH ARTICLE 5.4 OF THE NATIONAL STANDARD PLUMBING CODE.
- FLOORS DRAINING SHALL BE JAY R. SMITH MODEL NO. 2005, ROUND TOP WITH STAINLESS STEEL STRAINER. PROVIDE DEEP SEAL TRAP.
- ALL VENT PENETRATIONS THROUGH BUILDING ROOF SHALL BE MADE WATER-TIGHT BY THE USE OF PROPER FLASHING MATERIALS. SUBMIT FLASHING DETAILS FOR APPROVAL BY THE ARCHITECT.
- VENTS THRU ROOF SHALL NOT BE LESS THAN 3" TO PREVENT FROST CLOSURE. WHERE VENTS SMALLER THAN 3" ARE INDICATED ON THE DRAWINGS, INCREASE TO 3" SIZE AT LEAST 12" BELOW ROOF.
- VENTS SHALL TERMINATE NOT LESS THAN 6" ABOVE ROOF. VENTS SHALL NOT TERMINATE BELOW OR WITHIN 10' HORIZONTALLY OF ANY DOOR, WINDOW, FRESH AIR INTAKE OR OTHER VENTILATION OPENING, WHERE 10' HORIZONTAL CLEARANCE CANNOT BE MAINTAINED, EXTEND VENT TO AT LEAST 2' ABOVE VENTILATION OPENING.

DOMESTIC WATER

- DOMESTIC COLD AND HOT WATER PIPING SHALL BE CUPPER TYPE "L" FITTINGS SHALL BE BROUGHT COPPER, 1/2-3/8 SOLDER SHALL BE USED.
- ALL POTABLE WATER PIPING SHALL BE DISINFECTED AS PER ANNA STANDARD C601-54 AND AS REQUIRED BY THE LOCAL BUILDING AND HEALTH DEPARTMENT CODES.
- ANTI-WATER-HAMMER SHOCK ABSORBERS SHALL BE JAY R. SMITH "HYDRO-ROL" SIZED IN ACCORDANCE WITH THE MANUFACTURERS RECOMMENDATIONS.
- PROVIDE STOP VALVES FOR ALL DOMESTIC WATER CONNECTIONS TO FIXTURES EXCEPT WHERE GATE VALVES ARE INDICATED ON THE DRAWINGS.
- ALL HOSE BIBBS AND HYDRANTS SHALL BE PROVIDED WITH APPROVED VACUUM BREAKERS.
- PROVIDE CHROME PLATED, BRASS ANGLED STOP VALVES FOR ALL WATER CLOSETS, LAVS, SINKS, ETC.
- PROVIDE ASME TEMPERATURES AND PRESSURE RELIEF VALVES FOR ALL DOMESTIC WATER HEATERS.
- DISCHARGE OF ALL RELIEF VALVES SHALL BE PIPED TO THE FLOOR TO PREVENT ACCIDENTAL SCALDING.
- PROVIDE TWO (2) GATE VALVES AND TWO (2) UNIONS AND DRAIN VALVE WITH HOSE THREAD FOR EACH DOMESTIC WATER HEATER.

HANGERS AND SUPPORTS

- ALL FIXTURES SHALL BE SUPPORTED INDEPENDENTLY OF THE PIPING SYSTEM. SEE "FIXTURES" SECTION OF "NOTES AND SPECIFICATIONS" AND FIXTURE SCHEDULE NOTES.
- MAXIMUM SPACING OF SUPPORTS FOR VERTICAL PIPING SHALL NOT EXCEED:

TYPE OF PIPING	MAXIMUM SPACING
CAST IRON SOIL LINES THREADED STEEL PIPE COPPER TUBE	AT BASE AND EACH STORY AT EVERY OTHER STORY AT 10'-0" INTERVALS

PROVIDE RISER CLAMPS, WALL BRACKET HANGER, ETC., AS REQUIRED. HANGERS FOR P.V.C. PIPING SHALL BE AS APPROVED BY THE MANUFACTURER.
- MAXIMUM SPACING OF SUPPORTS FOR HORIZONTAL PIPING SHALL NOT EXCEED:

TYPE OF PIPING	MAXIMUM SPACING
CAST IRON SOIL PIPE THREADED STEEL PIPE (3/4" LESS THREADED STEEL PIPE (1" & LARGER) COPPER TUBE (1 1/4" & LESS) COPPER TUBE (1 1/2" & LARGER)	AT 5'-0" (10'-0" FOR 10" LENGTHS) AT 10'-0" INTERVALS AT 12'-0" INTERVALS AT 6'-0" INTERVALS AT 10'-0" INTERVALS
- ALL RISERS SHALL BE SUPPORTED AT THE BASE.
- PROVIDE CAPABILITY FOR EXPANSION AND CONTRACTION IN ALL PIPING AS INDICATED BELOW.

TYPE OF PIPING	TYPE OF PROVISIONS
DRAIN LINES IN UNHEATED AREAS DOMESTIC HOT WATER LINES	EXPANSION FITTINGS @ 12' EXPANSION LOOP @ 100'


INSULATION

- THE FOLLOWING PIPING SHALL BE INSULATED:
 - DOMESTIC COLD WATER
 - DOMESTIC HOT WATER
- INSULATION SHALL BE 1" RIGID FIBERGLASS AND SHALL BE MANVILLE "MORO-LOCK" OR APPROVED EQUAL. PROVIDE JACKETS AS SPECIFIED BELOW.
- JACKETS FOR GENERAL PURPOSE, INDOOR USE SHALL BE MANVILLE "AP-T PLUS" PRESSURE SENSITIVE LAP SEALING SYSTEM OR APPROVED EQUAL.
- JACKETS FOR OUTDOOR USE SHALL BE MANVILLE "ZESTON 2000" P.V.C. WITH "THERMA-HEAT" ADHESIVE OR APPROVED EQUAL.
- VALVES, FLANGES, ELBOWS, TEES, HUBS AND OTHER FITTINGS SHALL BE INSULATED USING MANVILLE "M-LO TEMP" FIBERGLASS INSERTS WITH MANVILLE "ZESTON 2000" P.V.C. FITTING COVERS SECURED WITH MANVILLE "THERMA-HEAT" ADHESIVE.
- ALL INSULATION SYSTEMS, INCLUDING INSULATION ADHESIVES AND JACKETS SHALL BE CERTIFIED IN ACCORDANCE WITH ASTM E84 FOR FLAME SPREAD RATING OF 25 OR LESS AND SMOKE DEVELOPED RATING OF 50 OR LESS.
- ALL BUT JOINTS OF INSULATION SECTIONS SHALL BE SEALED USING BUTT STRIPS AS RECOMMENDED BY THE MANUFACTURER FOR THE JACKET EMPLOYED.

FIXTURES

- SEE FIXTURE SCHEDULE FOR FIXTURE TYPES AND CONNECTION SIZES.
 - COORDINATE EXACT FIXTURE LOCATIONS FOR ROUGHINS WITH THE ARCHITECTURAL DRAWINGS.
 - WHERE ARCHITECTURAL DRAWINGS INDICATE TOILET ROOMS TO BE HANDICAPPED ACCESSIBLE OR HANDICAPPED ADAPTABLE COORDINATE FIXTURE CLEARANCE WITH N.J.A.C. 5:23-1 "BARRIER - FREE SUBCODE".
 - UNLESS OTHERWISE INDICATED, ALL FIXTURES SHALL BE "WHITE". COORDINATE ALL FIXTURE COLORS WITH THE ARCHITECT.
 - PROVIDE POP-UP DRAIN AND OVERFLOW FOR ALL LAVS.
- TESTING AND DISINFECTION
- ALL NEW PLUMBING SYSTEMS SHALL BE TESTED IN ACCORDANCE WITH THE NSFC.
 - SANITARY DRAINAGE SYSTEMS ROUGHING SHALL BE PRESSURE TESTED AT NOT LESS THAN 5 PSI FOR A PERIOD OF 15 MINUTES. PROVIDE TEST TEES, TEST PLUGS AND COMPRESSOR AS REQUIRED. THE FINAL SANITARY DRAINAGE SYSTEM SHALL BE SMOKE TESTED, WHERE APPROVED BY THE LOCAL AUTHORITY HAVING JURISDICTION, PERFORMANT MAY BE USED IN LIEU OF SMOKE TESTS.
 - DOMESTIC WATER SYSTEMS SHALL BE HYDROSTATIC TESTED A 150 PSI FOR NOT LESS THAN ONE HOUR.
 - ALL NEW DOMESTIC WATER SYSTEMS SHALL BE DISINFECTED USING A WATER CHLORINE SOLUTION AND IN ACCORDANCE WITH THE REQUIREMENTS OF NSFC ARTICLE 10.4.

PLUMBING SYMBOLS

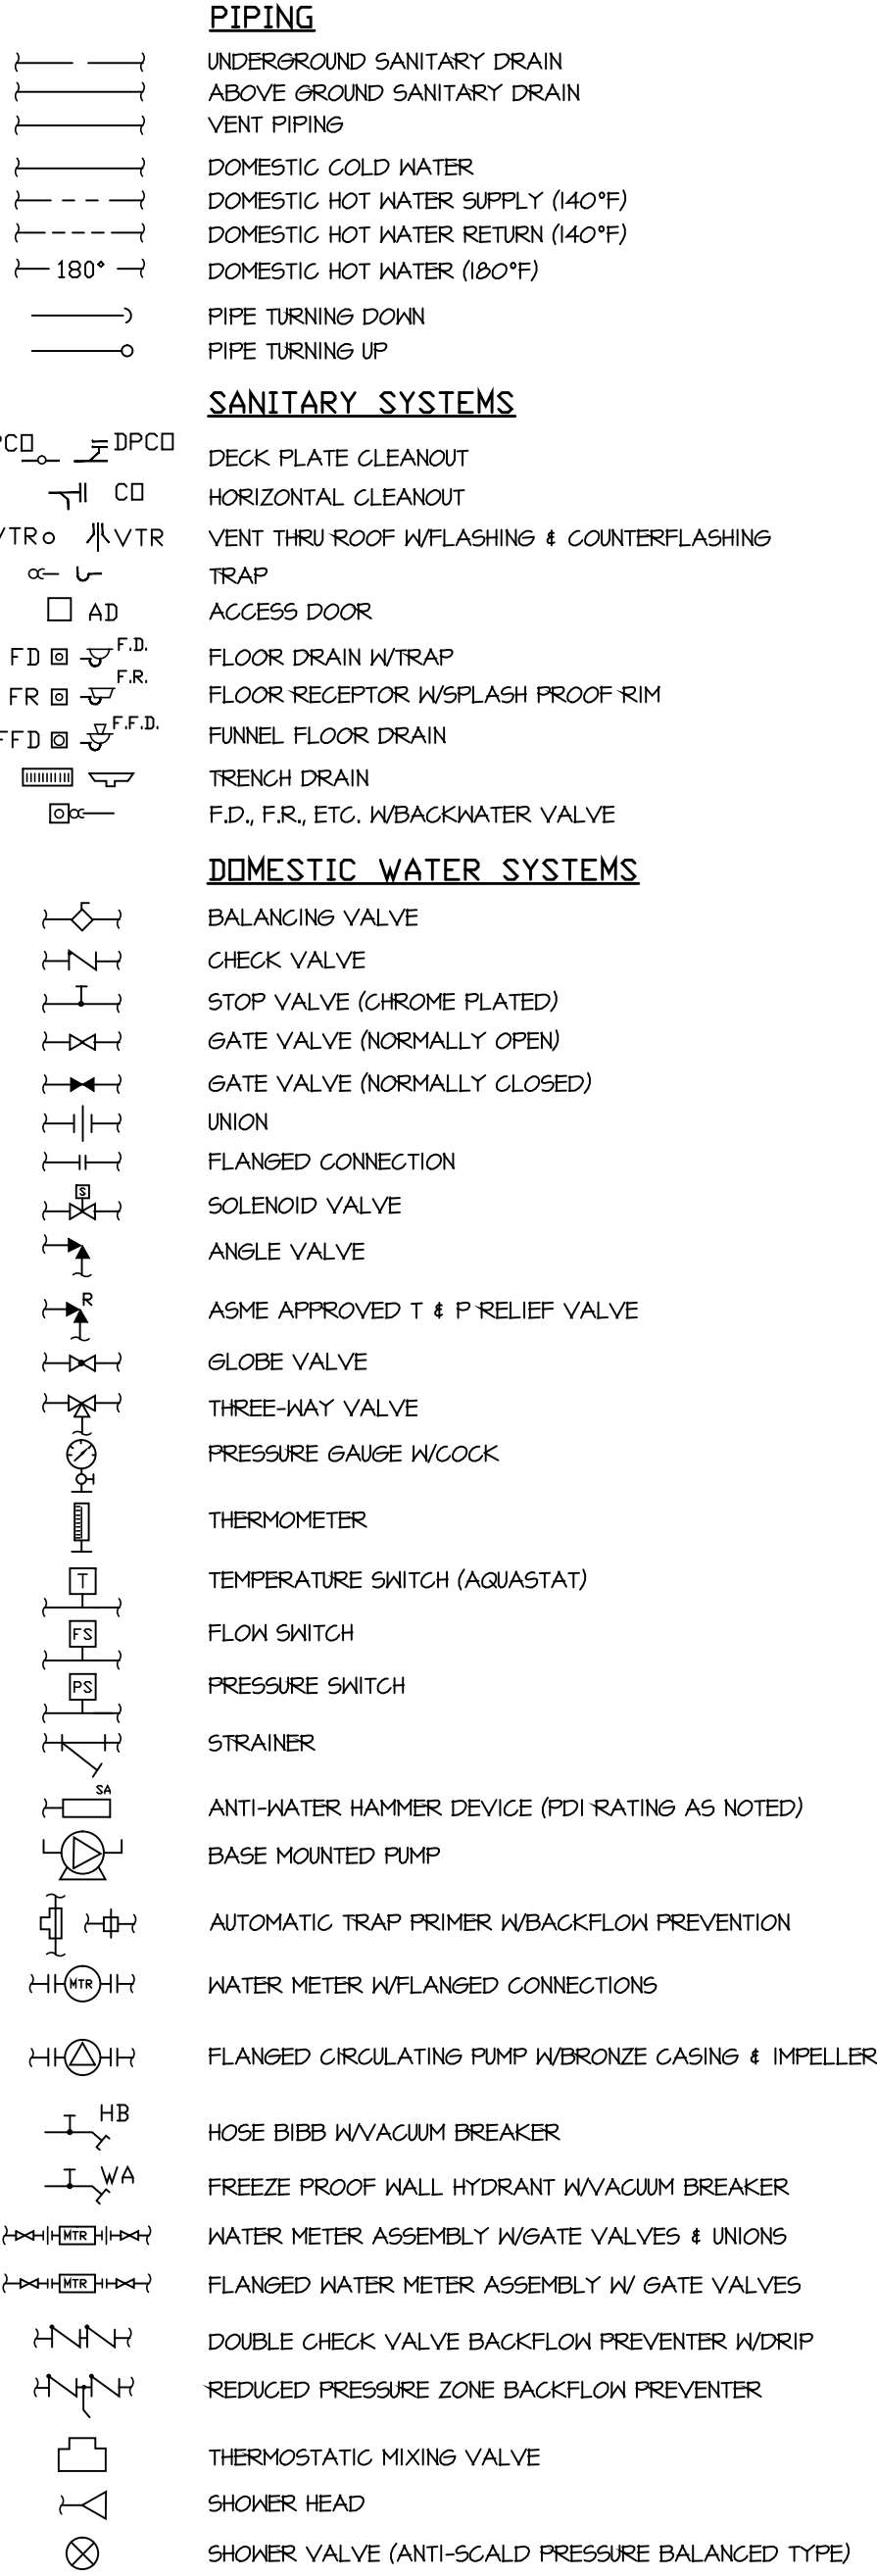


MISCELLANEOUS

CONNECT TO EXISTING

ABBREVIATIONS

ABOVE FINISHED FLOOR
BRITISH THERMAL UNITS
COMBUSTION AIR INTAKE
CAST IRON
COPPER
CUBIC FEET
COLD WATER
DUCTILE IRON
ELEVATION
FEET PER SECOND
GALLONS
GALLONS PER DAY
GALLONS PER HOUR
GALLONS PER MINUTE
HEAD
HORSEPOWER
HOT WATER
INSIDE DIAMETER
INTERNATIONAL PIPE SIZE
LINEAR FEET
NOT TO SCALE
OD
OD
PSI
PSIA
PSIG
REGULOR
SERVICE HEIGHT CAST IRON
VACUUM
WATER
XHCI

Key Plan

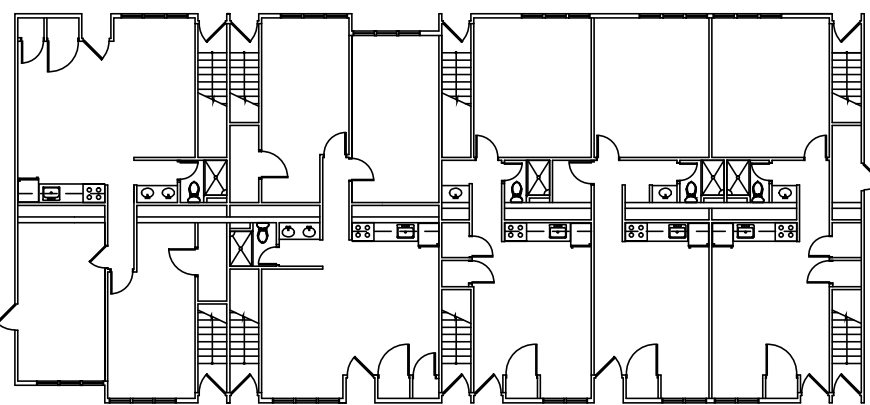

Consultants

LINWOOD ENGINEERING ASSOCIATES, P.A.

CONSULTING MECHANICAL & ELECTRICAL ENGINEERS

LEA 955 Lincoln Ave. 2301 Dupont Drive-Suite 150
Glen Rock, New Jersey Irvine, California
07452 92512
t: 201.857.3998 f: 714.424.0001
t: 201.857.3994 f: 714.424.0004
www.linwoodengineering.com

Michael T. Davina, P.E. Robert J. Hatch, P.E.

NJ #48654
CT #0025779
AR #13868
CA #E16118
CT #13318
FL #69560
MA #48516
NJ #30419
NV #019975
NY #56608
PA #036014-E

Project

INTERIOR RENOVATIONS
AT THE
BUTTERNUT - M RESIDENCE



505 Ramapo Valley Road
Mahwah, New Jersey 07430-1680

Client



505 Ramapo Valley Road
Mahwah, New Jersey 07430-1680

SNS Architects & Engineers, P.C.

1 PARAGON DRIVE . MONTVALE . NEW JERSEY . 07645
tel: 201.573.1767 fax: 201.573.0808 www.sns-arch-eng.com

Fay W. Logan, AIA

John M. Lignos, AIA

Lorin J. Sonenshine, AIA

Steven Napolitano, PE

Cert./Lic. No.

Date 04-23-15 Scale AS NOTED

Drawn By MD/Cadd Checked By sg

Dwg. Title

PLUMBING NOTES, SYMBOLS &
SCHEDULES

Work Order No. Dwg. No.

4698M PO01