


SECOND FLOOR FIRE PROTECTION PLAN
SCALE: 1/4"=1'-0"

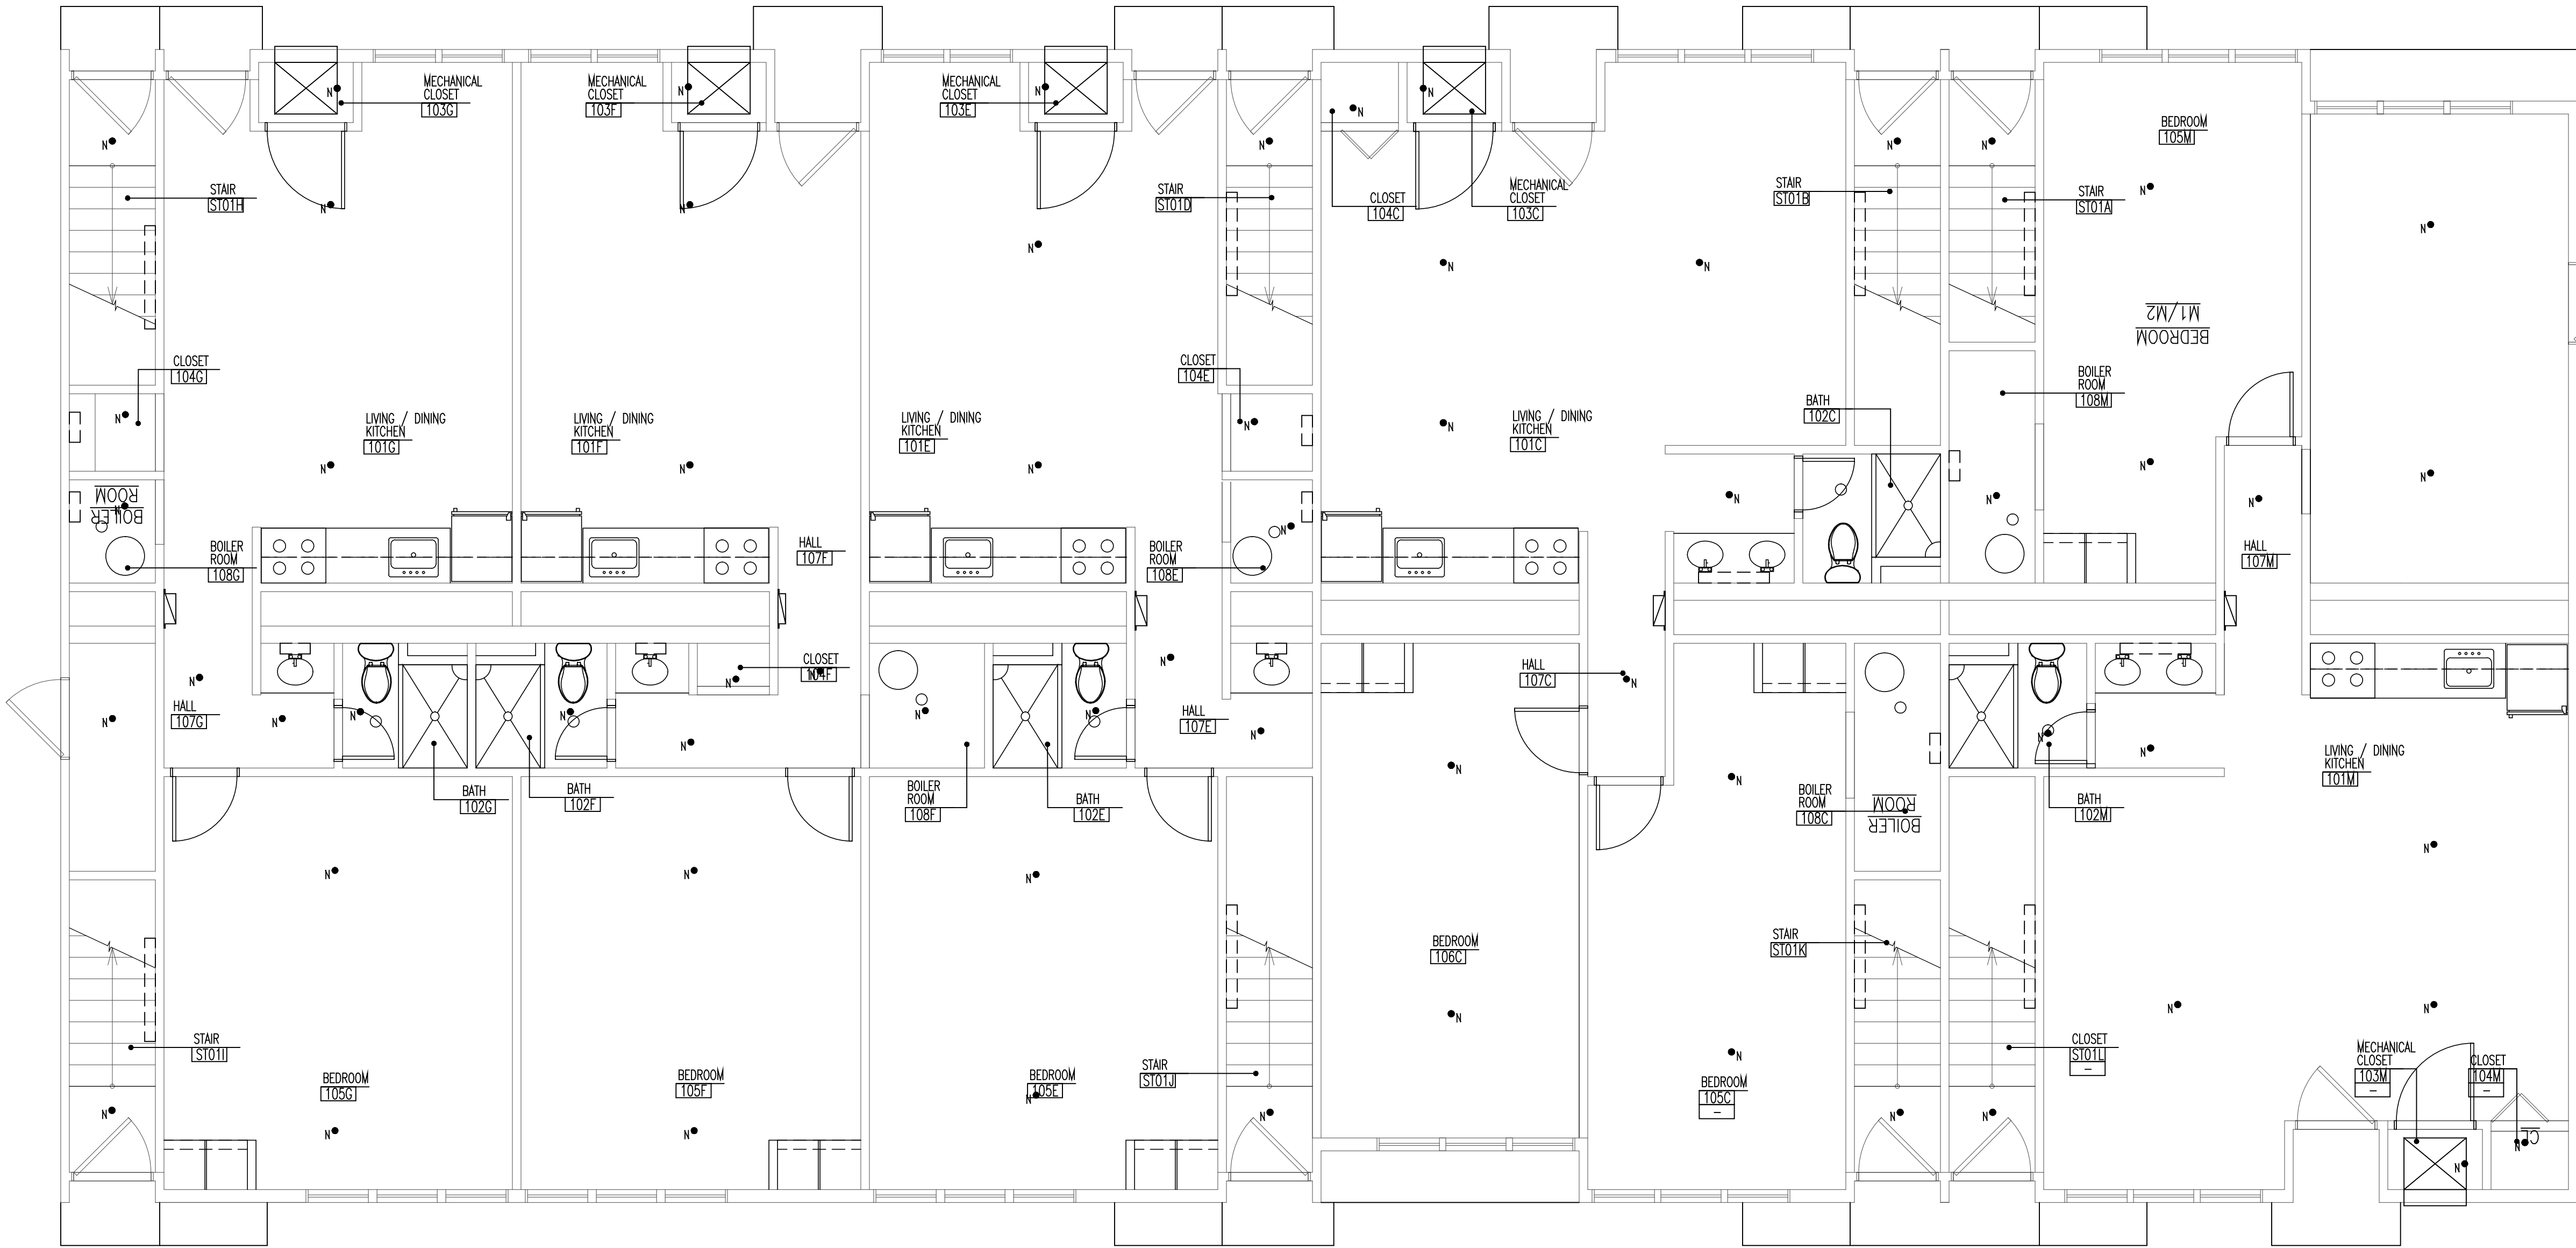

FIRST FLOOR FIRE PROTECTION PLAN
SCALE: 1/4"=1'-0"

NOTE:
ALL FIRE PROTECTION SYSTEM DEVICES
AND FIRING SHOWN ARE DIAGRAMMATICAL
AND ARE FOR REFERENCE ONLY.
CONTRACTOR IS RESPONSIBLE TO FIELD
VERIFY EXISTING CONDITIONS, INCLUDING
BY NOT LIMITED TO: NUMBER OF
SPRINKLER HEADS, PIPE SIZES, DEVICE
LOCATIONS AND ASSOCIATED CONTROLS.
CONTRACTOR SHALL DESIGN AND INSTALL
A NEW FIRE PROTECTION SYSTEM AS PER
REQUIREMENTS OF NFPA 13 AND
AUTHORITY HAVING JURISDICTION FOR THIS
TYPE OF BUILDING CLASSIFICATION (R-2).
CONTRACTOR SHALL PERFORM WATER
FLOW TESTS, PROVIDE SIGNED AND
SEALED HYDRAULIC CALCULATIONS AND
FIRE PROTECTION PLANS, ALONG WITH
FIRE PROTECTION EQUIPMENT SHOP
DRAWINGS, TO THE ARCHITECT/ENGINEER
FOR REVIEW AND SUBMISSION TO NJ DCA.

Michael T. Davina, P.E.
NJ #48654
CT #0025779

Robert J. Hatch, P.E.
AR #13868
CA #E16118
CT #15318
FL #69560
MA #48516
NJ #35419
NV #019975
NY #56608
PA #036014-E

Revisions		
Date	Issue	Description
06-03-15	1	ISSUED FOR CONSTRUCTION
11-16-15	2	REVISED PER NJDOCA ELECTRONIC STAMP



Consultants

LINWOOD ENGINEERING ASSOCIATES, P.A.

CONSULTING MECHANICAL & ELECTRICAL ENGINEERS

LEA 955 Lincoln Ave. 2301 Dupont Drive-Suite 150
Glen Rock, New Jersey Irvine, California
07452 92612
t: 201.857.3998 t: 714.424.0001
f: 201.857.3994 f: 714.424.0004
www.linwoodengineering.com

Project

INTERIOR RENOVATIONS
AT THE
BUTTERNUT - M RESIDENCE

RAMAPO COLLEGE
OF NEW JERSEY
505 Ramapo Valley Road
Mahwah, New Jersey 07430-1680

Client

RAMAPO COLLEGE
OF NEW JERSEY
505 Ramapo Valley Road
Mahwah, New Jersey 07430-1680

SNS Architects & Engineers, PC
1 PARAGON DRIVE, MONTVALE, NEW JERSEY, 07645
tel: 201.573.1767 fax: 201.573.0808 www.sns-arch-eng.com

Fay W. Logan, AIA
John M. Lignos, AIA
Lorin J. Sonenshine, AIA
Steven Napolitano, PE

Cert./Lic. No.
Date 04-23-15 Scale AS NOTED
Drawn By PJC/ack Checked By MD
Dwg. Title
FIRST & SECOND FLOOR FIRE
PROTECTION PLANS
Work Order No. Dwg. No.
4698M FP200