


MATCH  
LINE

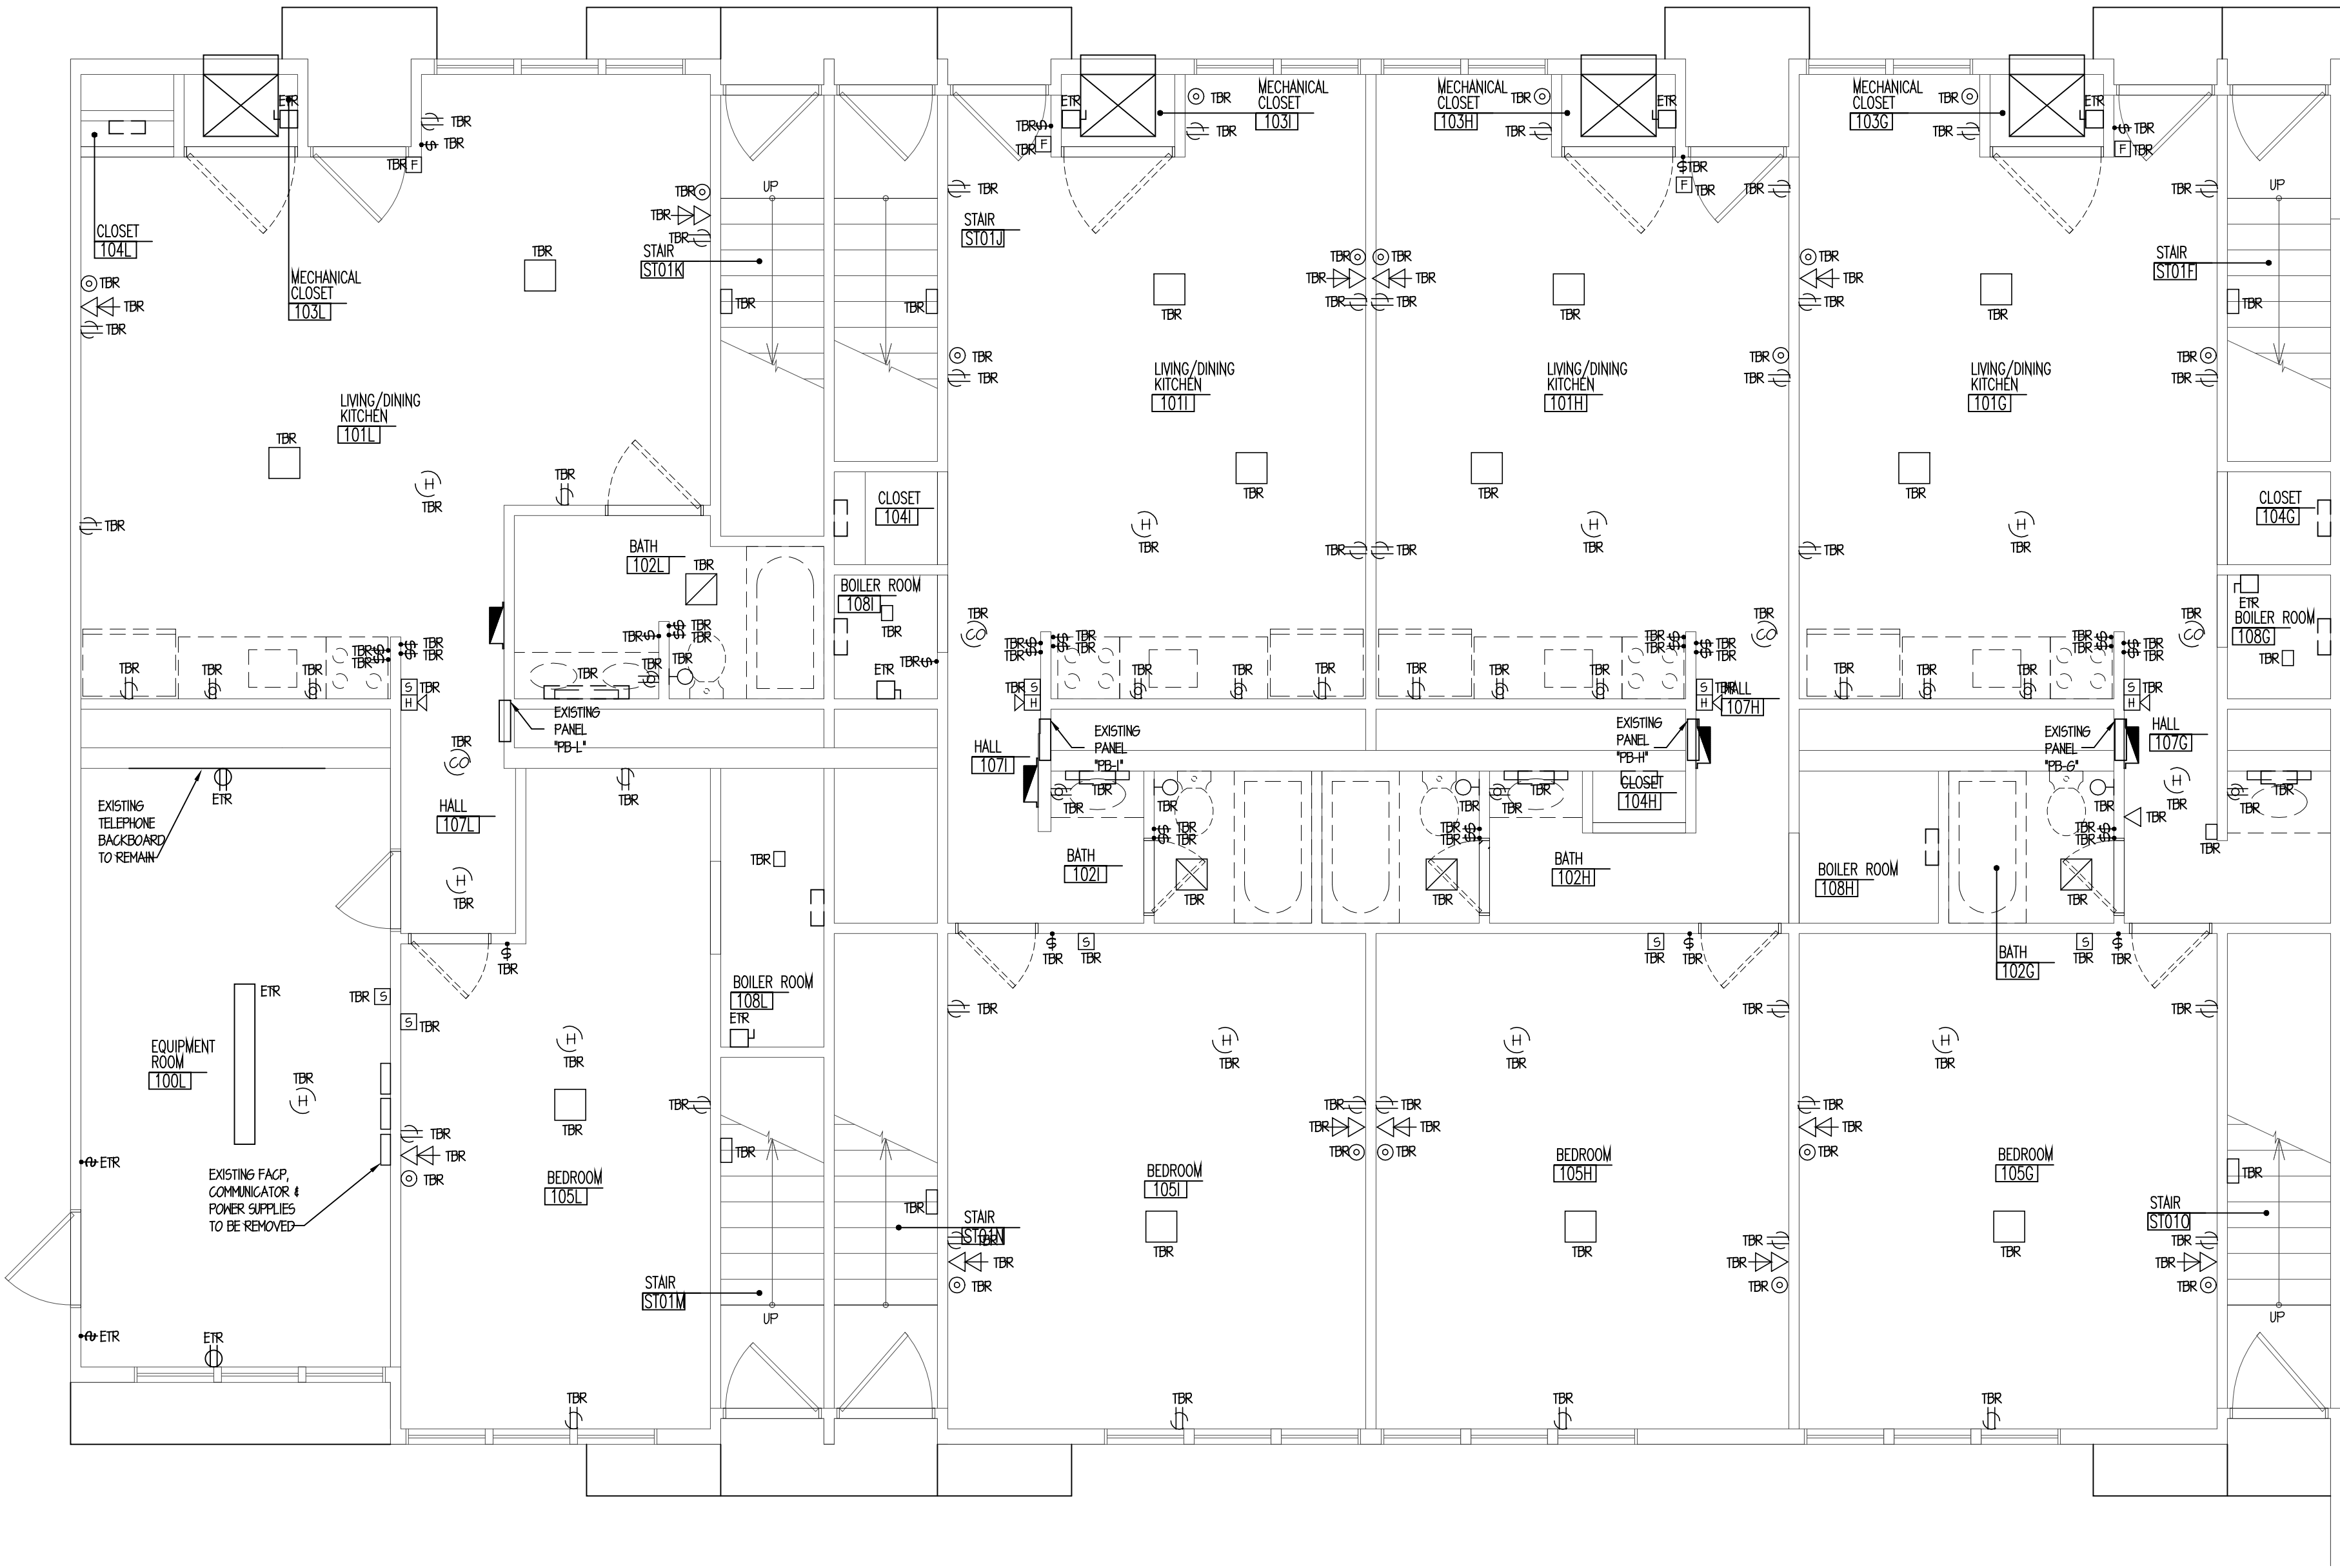


**ELECTRICAL DEMOLITION NOTES:**

1. DO NOT CONSIDER DEMOLITION AND ALTERATION NOTES TO BE ALL INCLUSIVE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO INSPECT AND ASSESS EACH SPACE, AND TO FULFILL THE INTENT OF THE WORK INDICATED BY THE CONTRACT DOCUMENTS. VERIFY ALL DIMENSIONS WITHIN THE CONTRACT LIMITS, BRING DEVIATIONS FROM THE CONTRACT DOCUMENTS NOTICED BY FIELD CONDITIONS TO THE ATTENTION OF THE ARCHITECT.
2. CONTRACTOR SHALL DISCONNECT AND MAKE SAFE ALL AREAS PRIOR TO GENERAL DEMOLITION BY THE GENERAL CONTRACTOR. THIS SHALL INCLUDE ALL MECHANICAL EQUIPMENT, CONTROL SYSTEMS AND ACCESSORIES. ELECTRICAL CONTRACTOR SHALL REFER TO MECHANICAL DRAWINGS FOR MECHANICAL EQUIPMENT REQUIRING DISCONNECT/DEMOLITION. CONTRACTOR TO PROVIDE TEMPORARY LIGHTING IN AREA OF WORK. TEMPORARY LIGHTING IS TO REMAIN AT COMPLETION OF PROJECT. TEMPORARY LIGHTING SHALL PROVIDE A MINIMUM OF 30 FOOT CANDLES THROUGHOUT AREA OF WORK.
3. DO ALL NECESSARY DEMOLITION AND REMOVAL OF EXISTING LIGHTING, EXISTING FIRE ALARM SYSTEM AND ELECTRICAL EQUIPMENT AS REQUIRED.
4. DEMOLITION TO BE PERFORMED AFTER NORMAL WORKING HOURS IF REQUIRED BY THE OWNER.
5. RESOLVE AND RECONNECT ALL CIRCUITING TO EXISTING LOADS WHICH ARE TO REMAIN IF SAME IS DISTURBED BY DEMOLITION WORK. PROVIDE NEW HOME RING, IF REQUIRED.
6. CONDUITS COMING UP OUT OF FLOOR SLAB WHICH ARE TO BE REMOVED SHALL BE CUT BACK BELOW TOP OF FINISHED SLAB TO PERMIT PATCHING.
7. DISCONNECT AND REMOVE ALL EXISTING WIRING AND EXPOSED CONDUITS NOT BEING RETAINED OR REUSED.
8. REMOVE ALL DEVICES AND ASSOCIATED WIRING AND CONDUITS FROM EXISTING OUTLETS, SWITCHES, FIRE ALARM DEVICES, ETC., BEING REMOVED TO PERMIT PATCHING OVER THE ARCHITECTURAL SURFACE.
9. WHERE EXISTING WIRING AND CIRCUITRY WHICH IS TO REMAIN IS LEFT EXPOSED BY DEMOLITION AND REMOVAL OF PARTITION AND/OR FLOOR CEILING, RESOLVE SUCH WIRING TO MAINTAIN THE CIRCUIT CONTINUITY.
10. WHERE EXISTING LIGHTING EQUIPMENT, WIRING, ETC. IS INDICATED AS REMAINING AND SUCH ITEMS INTERFERE WITH THE INSTALLATION OR THE DEMOLITION WORK OF OTHER TRADES, DISCONNECT, REMOVE, AND RELOCATE TO AVOID CONFLICTS. REINSTALL AND RECONNECT SUCH ITEMS AS REQUIRED.
11. WHERE EXISTING LIGHTING FIXTURES AND DEVICES ARE BEING REMOVED AND SUCH REMOVAL DISTURBS THE CIRCUITRY TO LIGHTING FIXTURES AND DEVICES WHICH ARE TO REMAIN, PROVIDE ALL NECESSARY MODIFICATIONS AND ADDITIONS TO WIRING AS REQUIRED TO RETAIN SERVICE AND SWITCH CONTROL.
12. RELOCATE EXISTING ACTIVE OUTLET BOXES, JUNCTION BOXES, ETC., WHICH ARE RENDERED INACCESSIBLE BY NEW CONSTRUCTION.
13. ALL ELECTRICAL DEMOLITION WORK SHALL BE DONE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND THE NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) STANDARDS.

**Revisions**

Date	Issue	Description
06-03-15	1	ISSUE FOR CONSTRUCTION

**Key Plan**

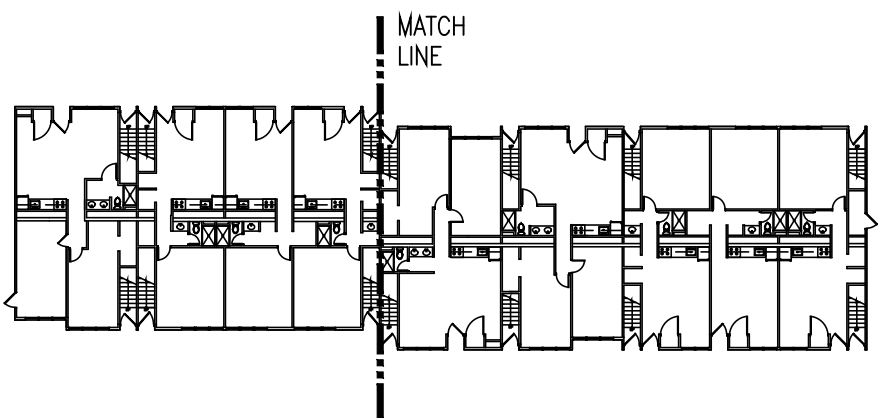

**Consultants**

**LINWOOD ENGINEERING ASSOCIATES, P.A.**

CONSULTING MECHANICAL & ELECTRICAL ENGINEERS

**LEA** 955 Lincoln Ave. 2301 Dupont Drive-Suite 150  
Glen Rock, New Jersey Irvine, California  
07452 92612  
t: 201.857.3998 f: 714.424.0001  
t: 201.857.3994 f: 714.424.0004  
www.linwoodengineering.com

**Michael T. Davina, P.E. Robert J. Hatch, P.E.**

NJ #48654 AR #13868  
CT #0025779 CA #E16118  
CT #13318 CT #13318  
FL #69560  
MA #48516  
NJ #30419  
NV #019975  
NY #56608  
PA #036014-E

**Project**

INTERIOR RENOVATIONS  
AT THE  
**TAMARACK - N RESIDENCE**



505 Ramapo Valley Road  
Mahwah, New Jersey 07430-1680

**Client**



505 Ramapo Valley Road  
Mahwah, New Jersey 07430-1680

**SNS Architects & Engineers, PC**

1 PARAGON DRIVE, MONTVALE, NEW JERSEY 07645  
tel: 201.573.1767 fax: 201.573.0808 www.sns-arch-eng.com

Fay W. Logan, AIA  
John M. Lignos, AIA  
Lorin J. Sonenshine, AIA  
Steven Napolitano, PE

Cert./Lic. No.  
Date 04-10-15 Scale AS NOTED  
Drawn By MD Checked By SG

**FIRST FLOOR ELECTRICAL DEMOLITION PLAN**

Work Order No. Dwg. No.

**4698N E100**

MATCH  
LINE

**FIRST FLOOR ELECTRICAL DEMOLITION PLAN**  
SCALE: 1/4"=1'-0"