
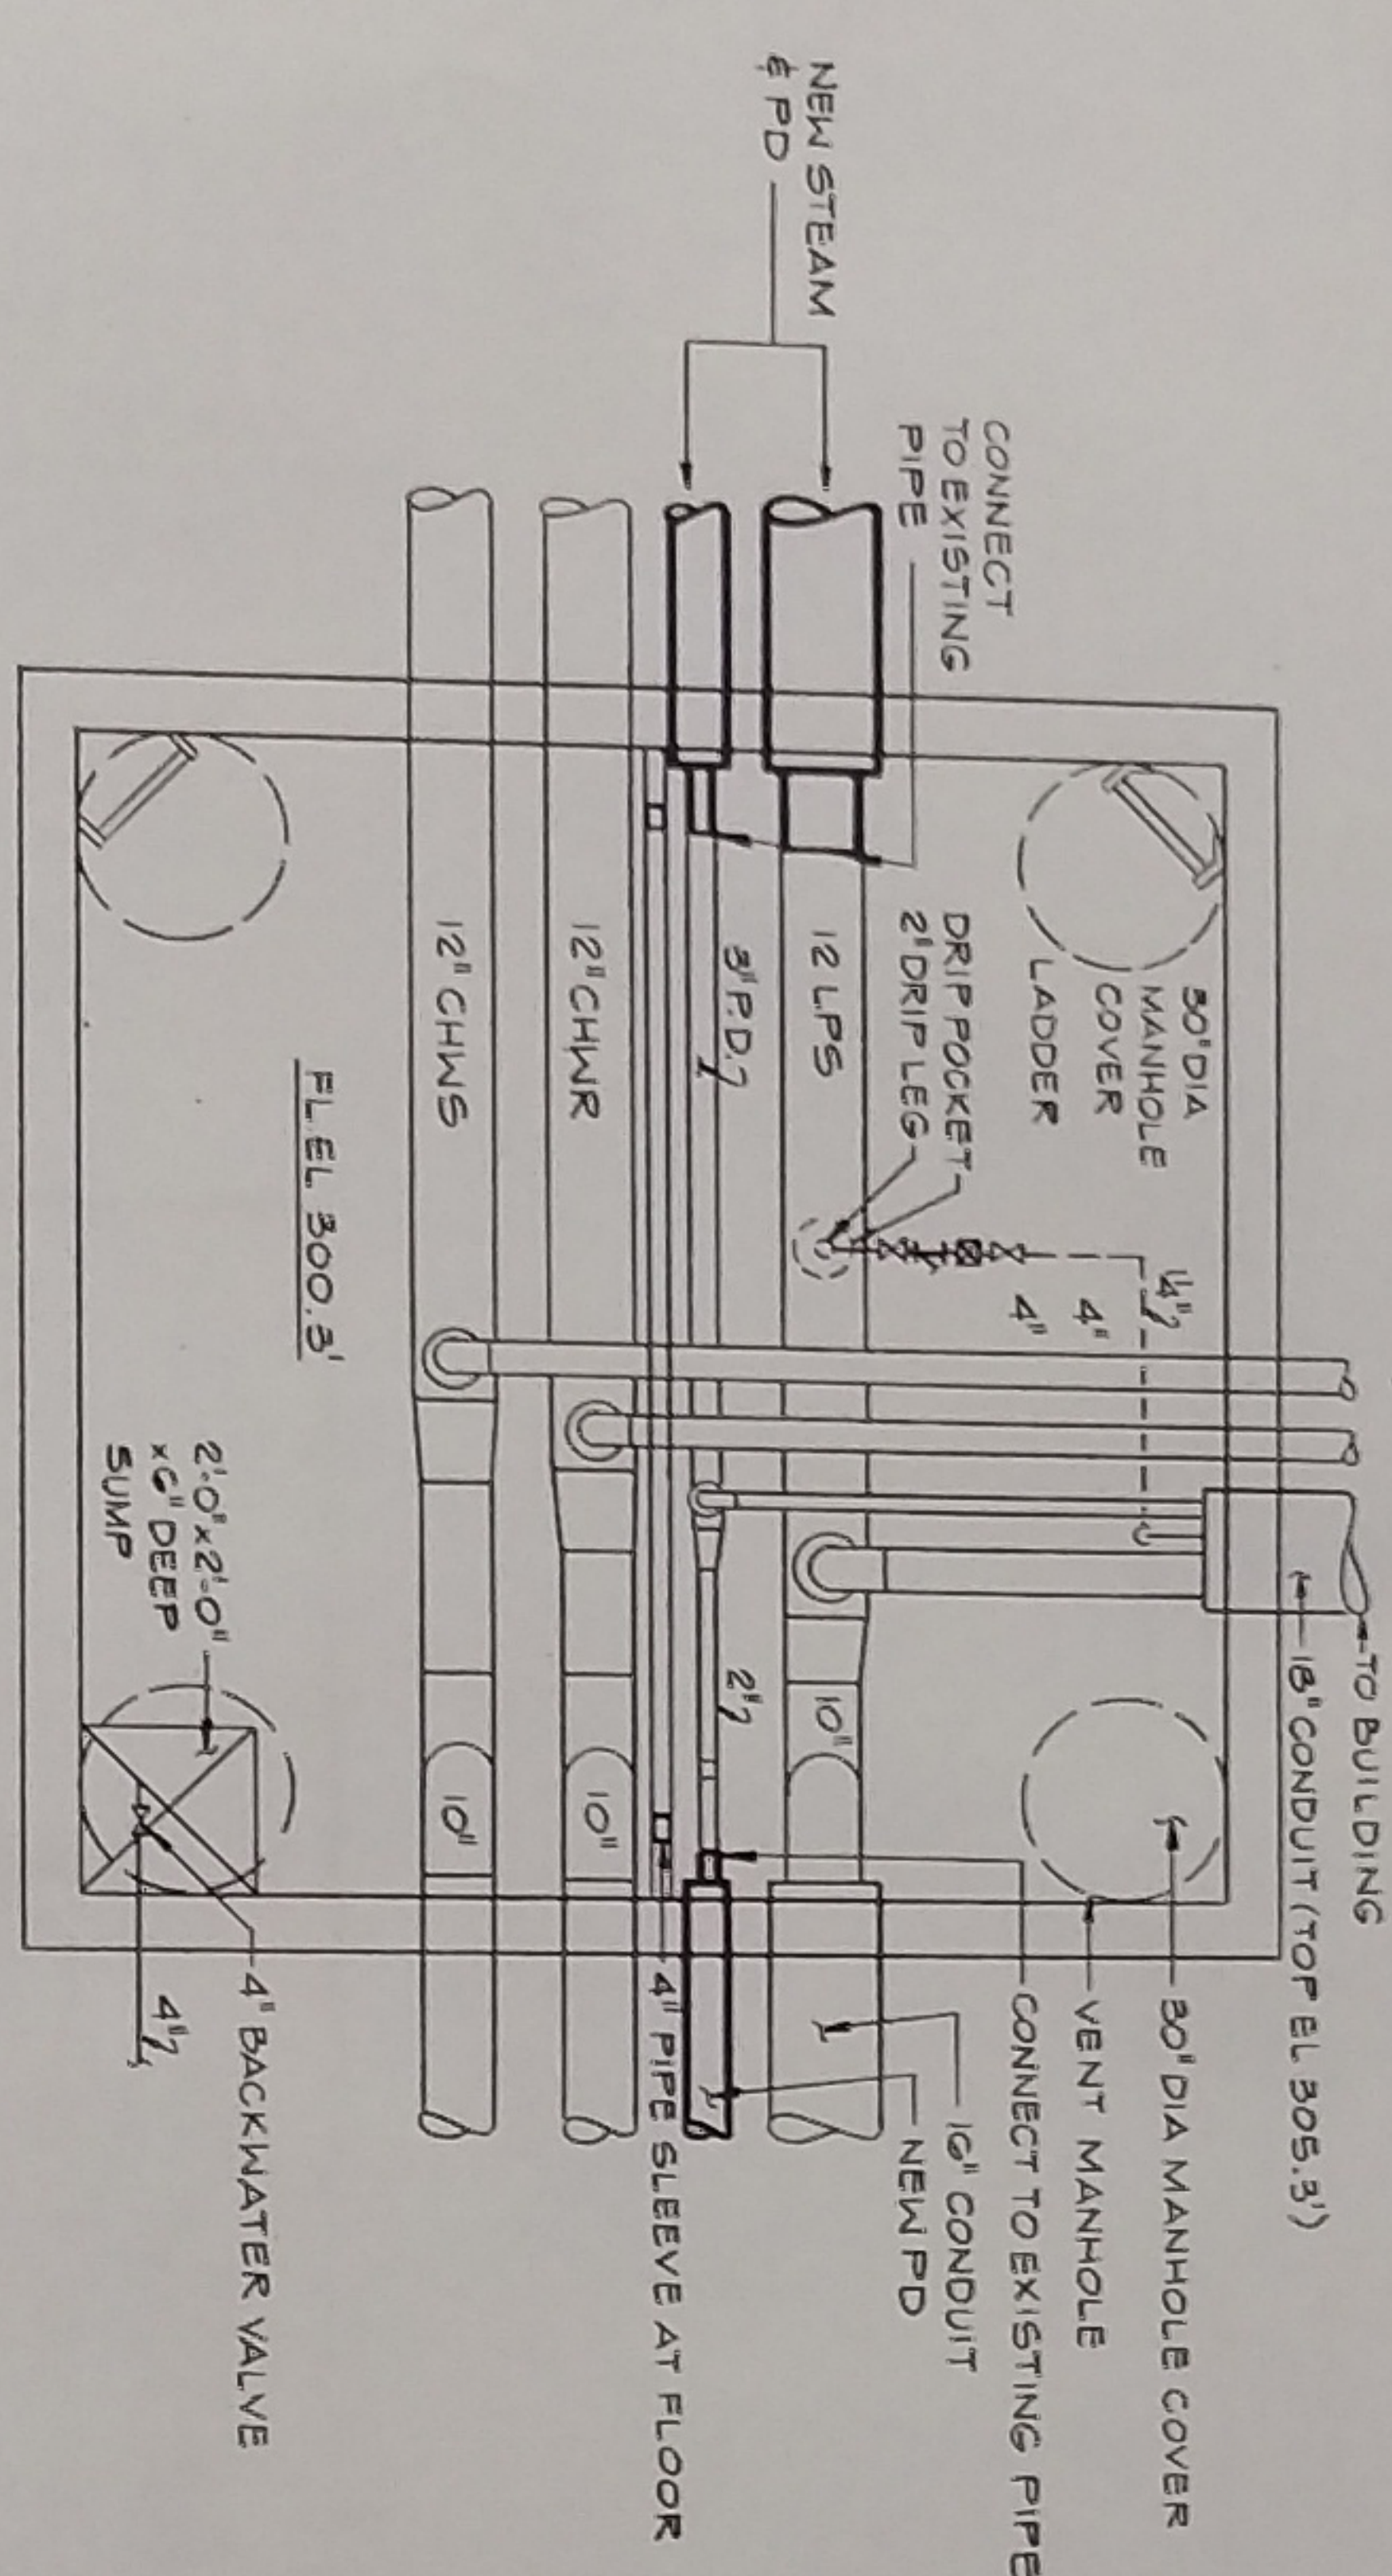



Contractor to remove old and install new Thermacor 12" steam and 3" condensate line and tie into existing system.

LEGEND

PO PUMP DISCHARGE
BTM LOW PRESSURE (MIN MAX) STRAIN
CHMS CHILLED WATER SUPPLY
CHMS CHILLED WATER RETURN
X ANCHOR

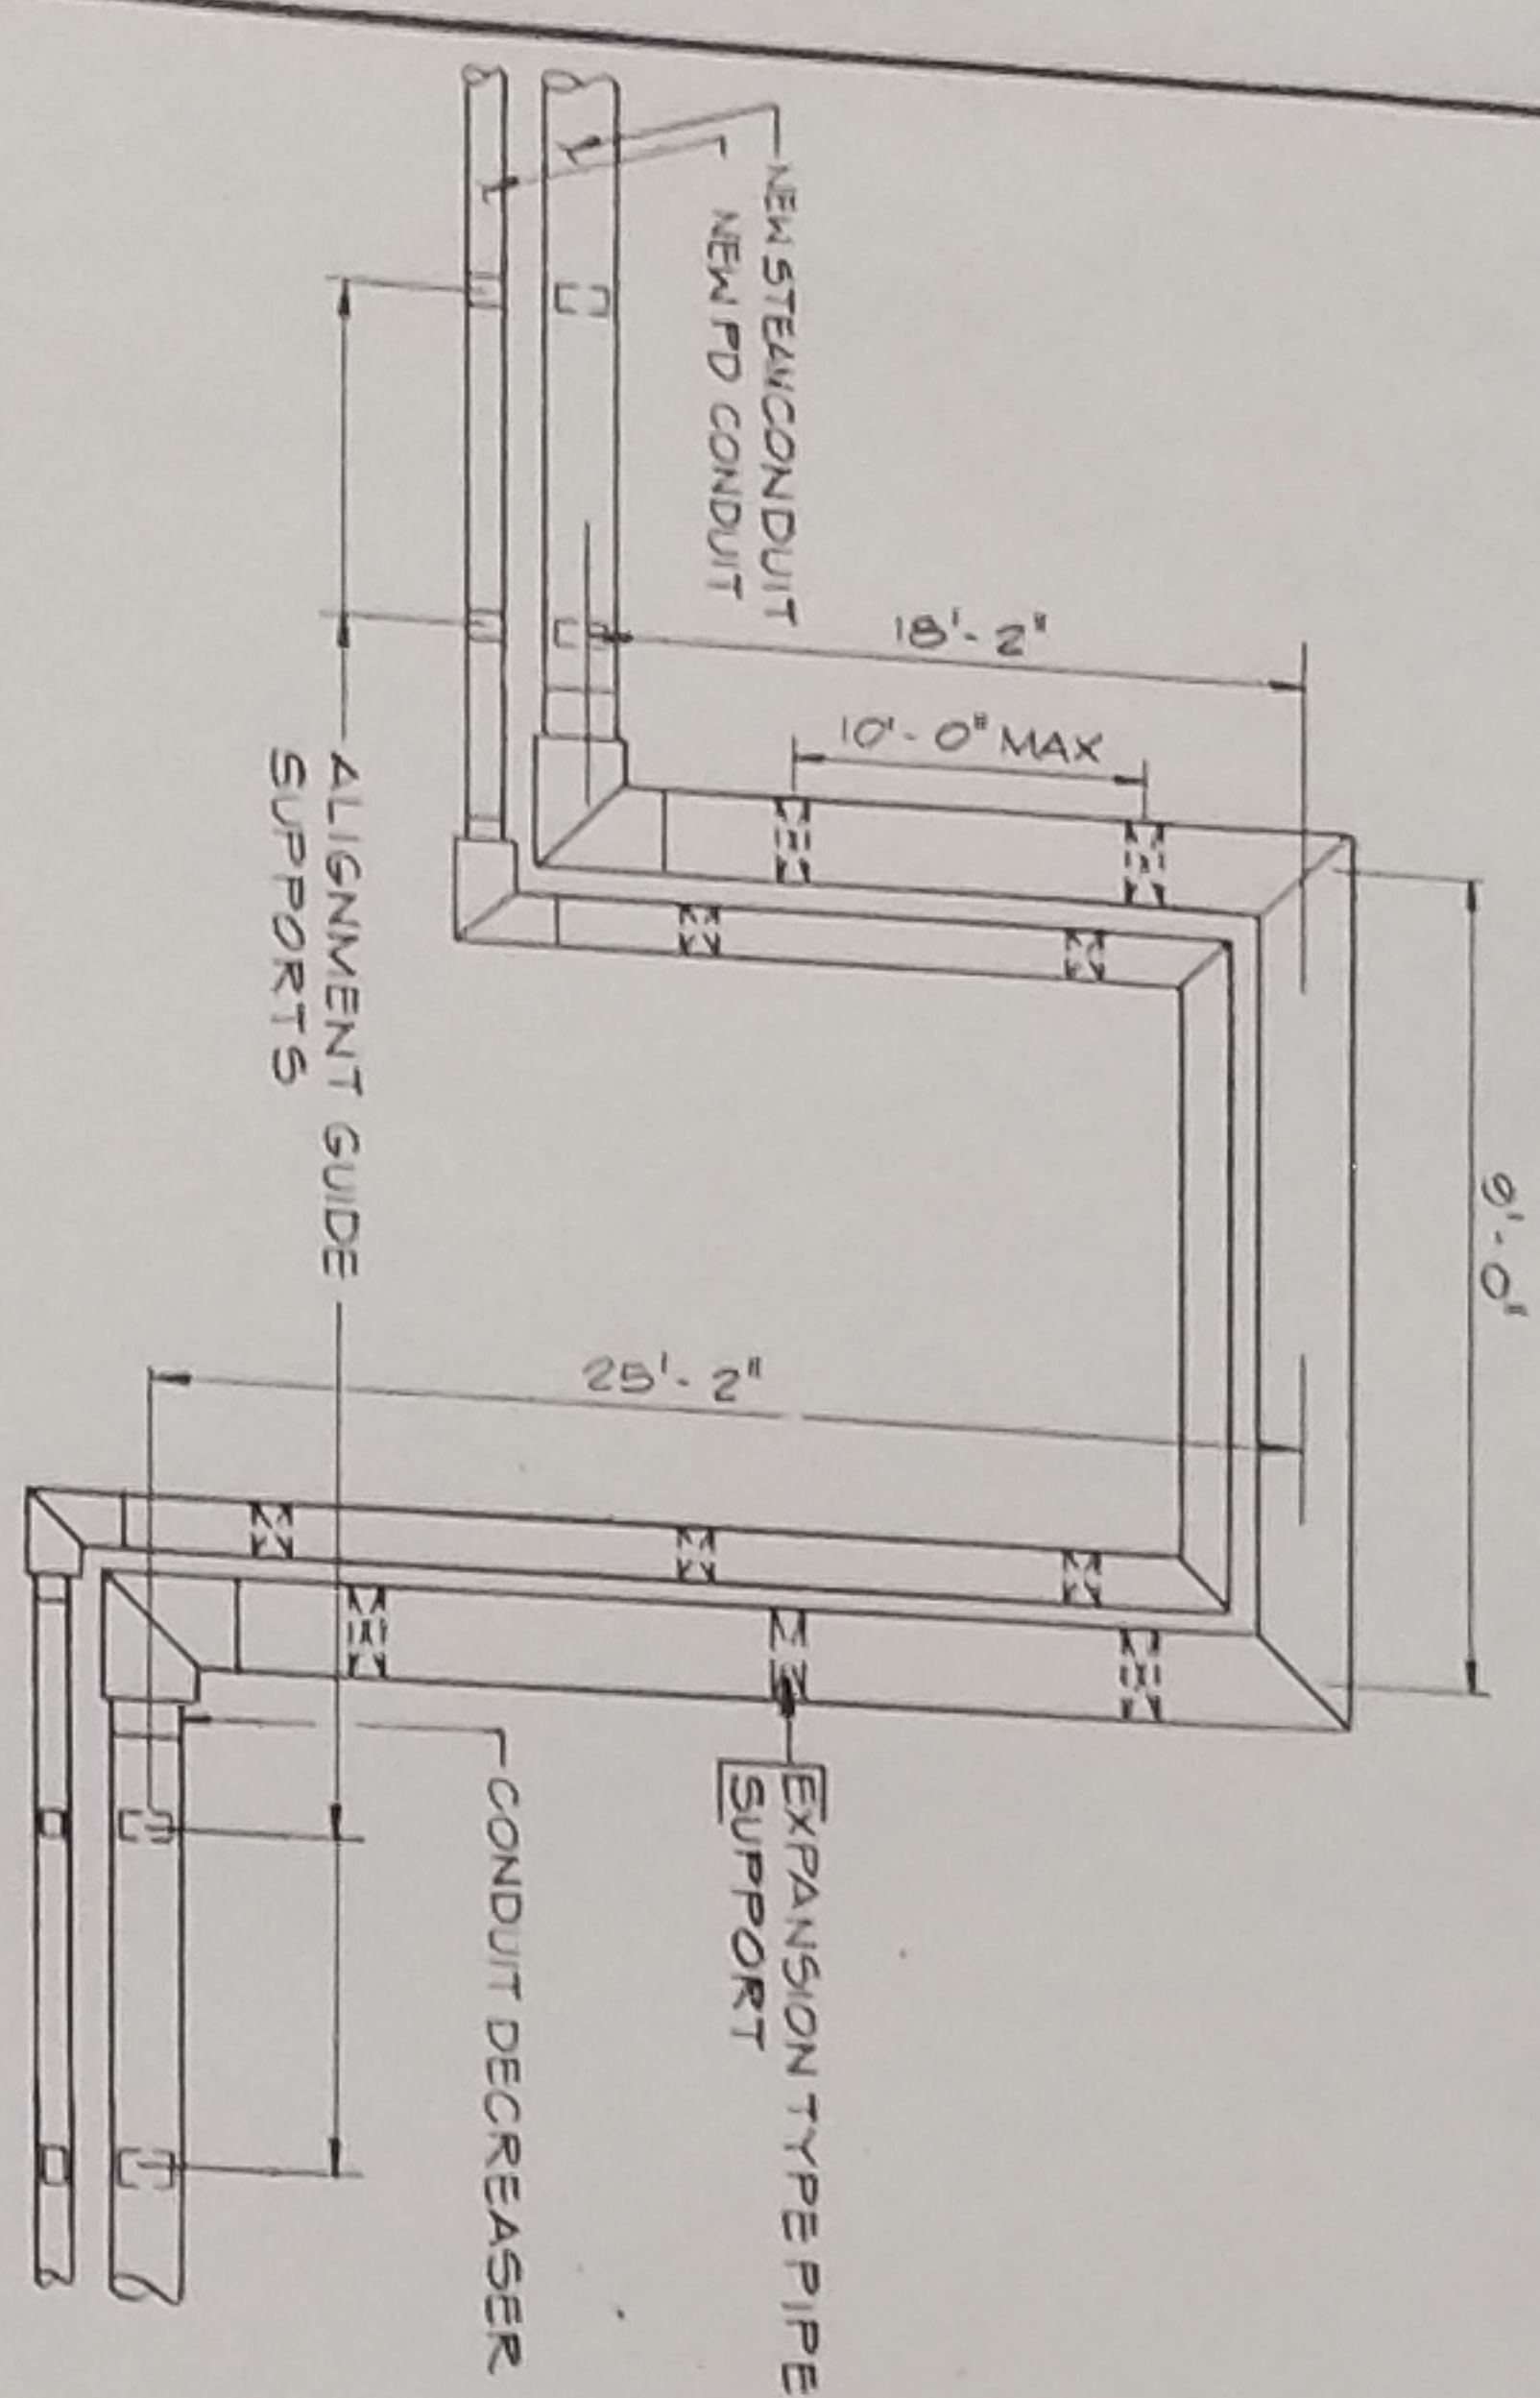


MANHOLE #3 PLAN

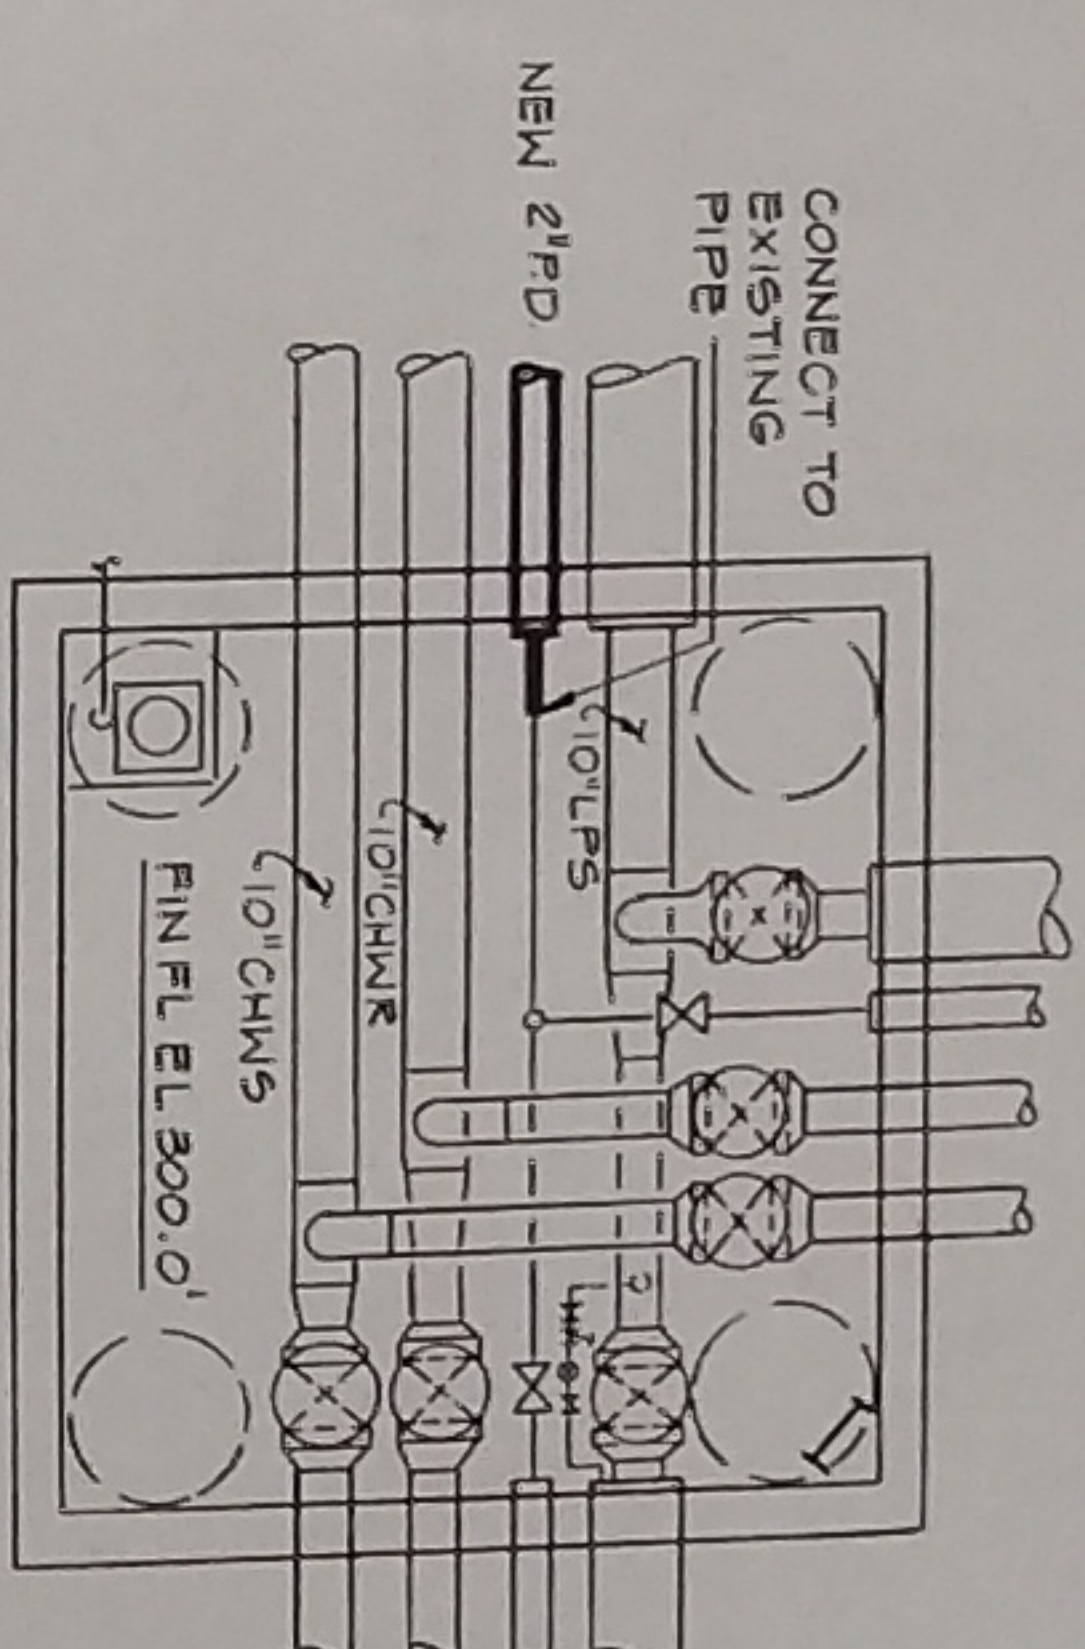

MANHOLE #4 PLAN

NOTE - ALL WORK EXISTING
EXCEPT AS INDICATED
NEW

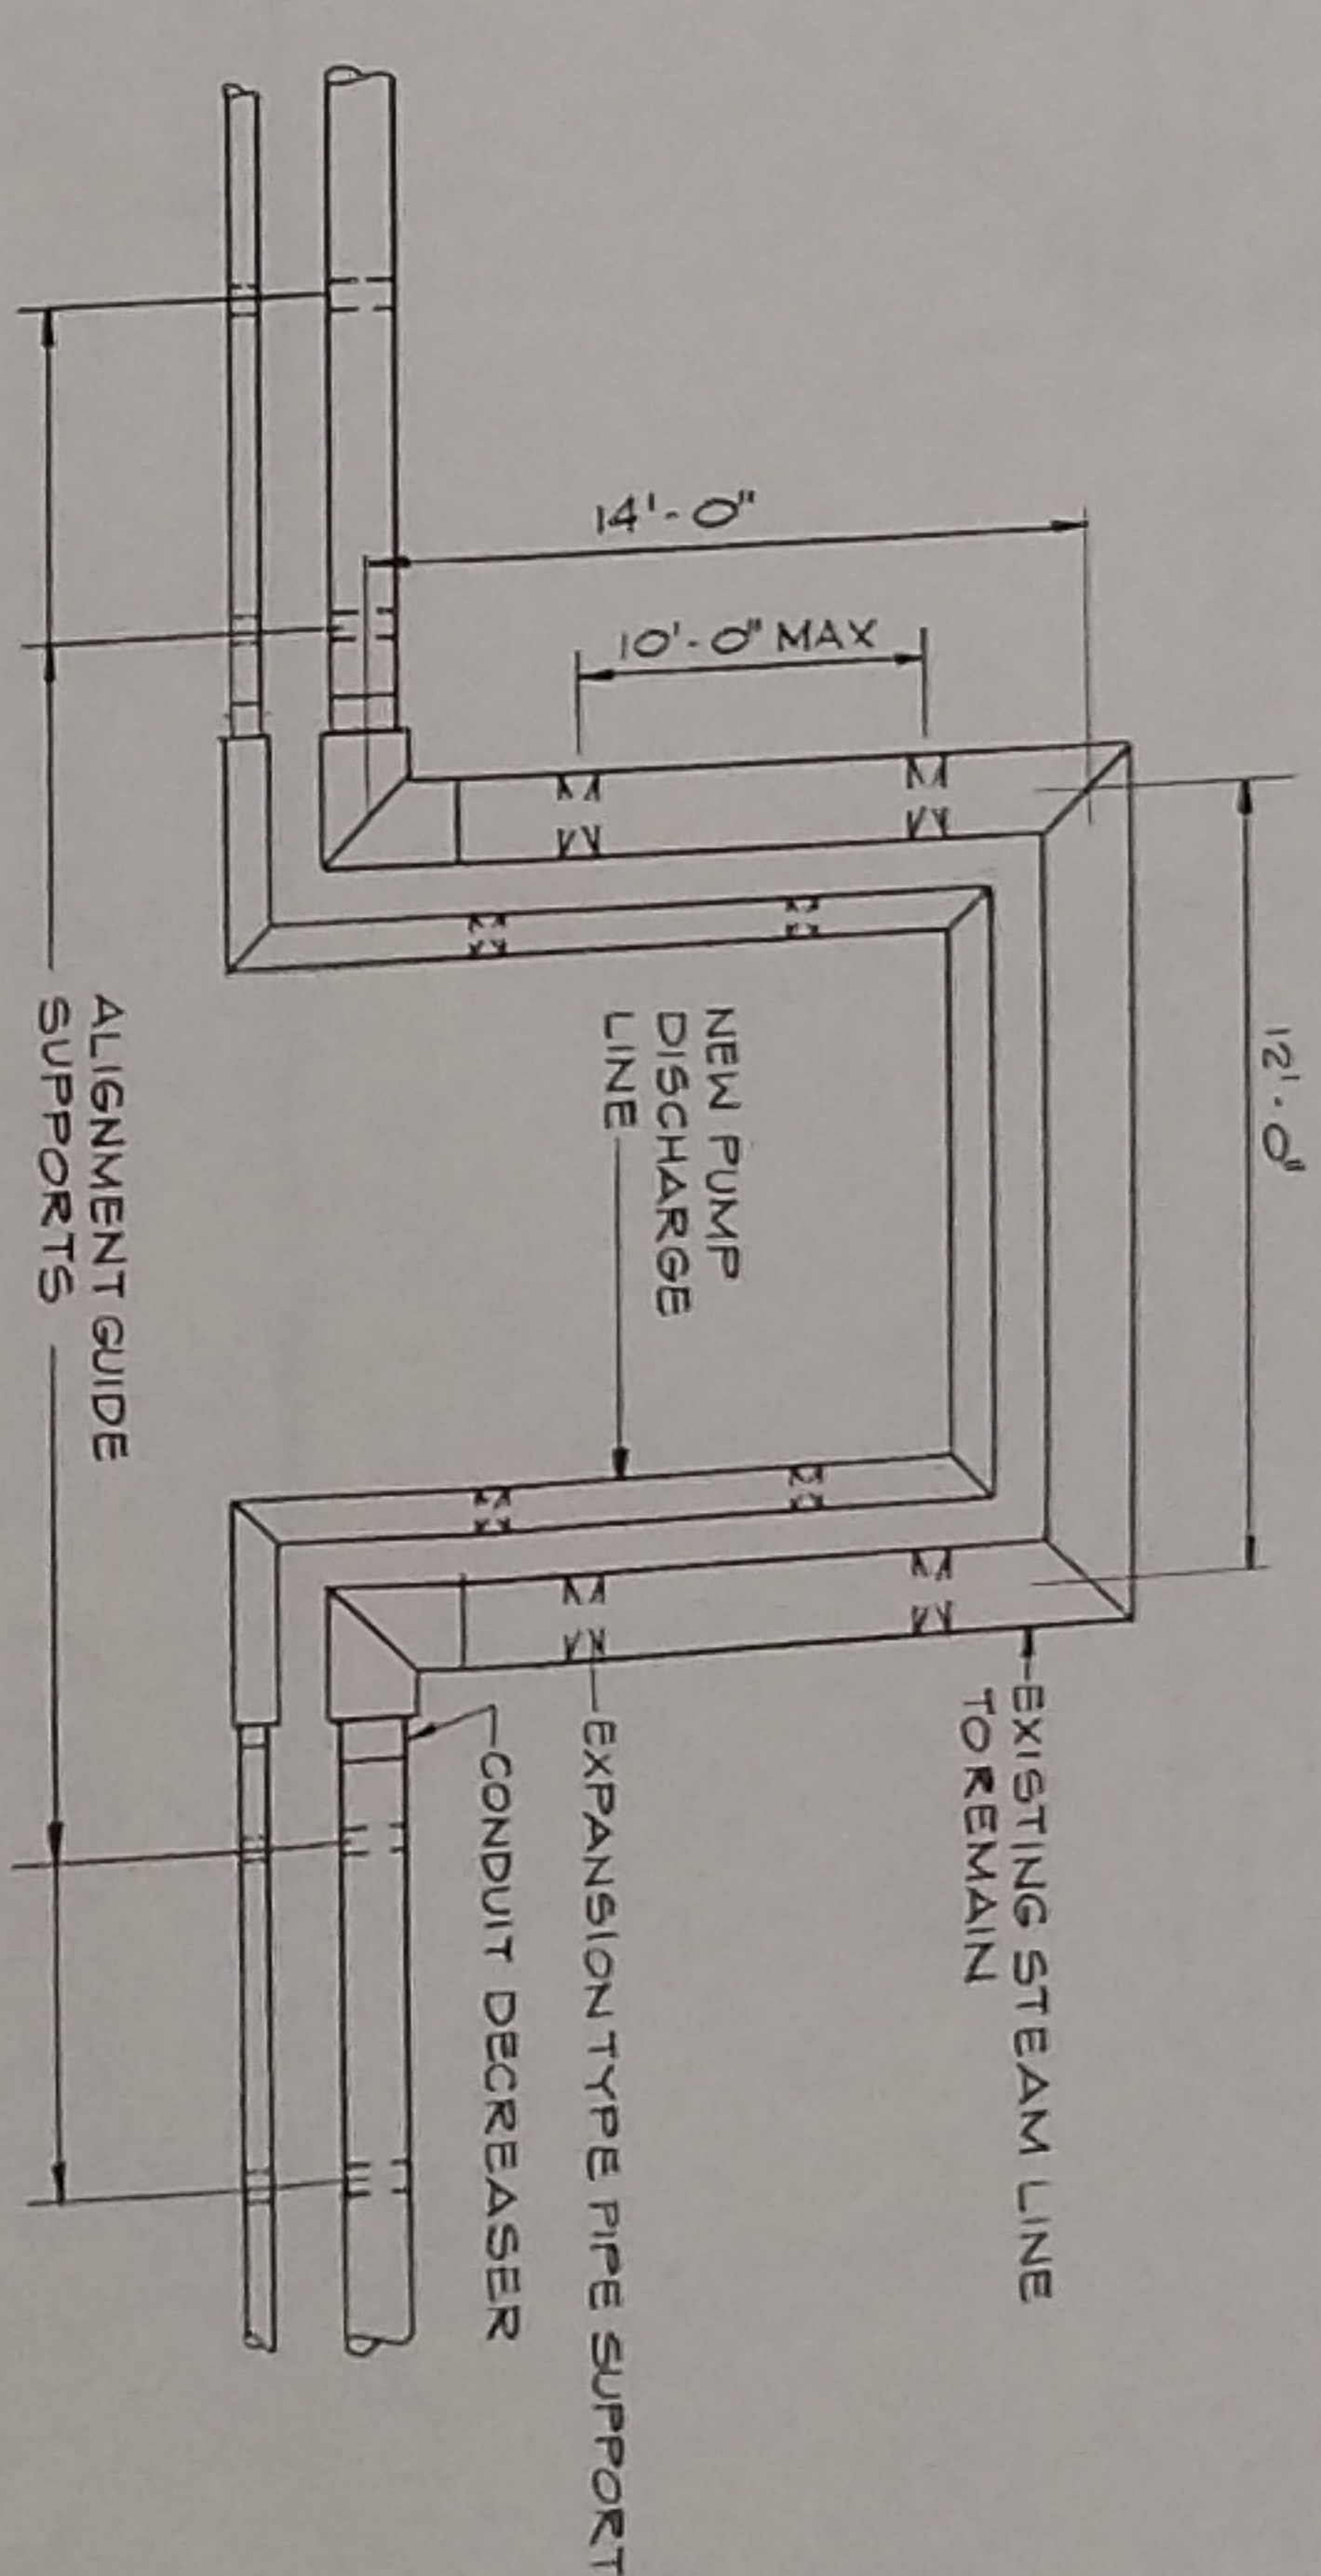

EXPANSION LOOP DETAIL
NO SCALE
LOOP #2

STREET NAME	DISPOSITION
RAMAPO COLLEGE	
WAHMAM, NEW JERSEY	
BARRETT ASSOCIATES, INC.	
CONSULTING ENGINEERS	
172 ROCK ROAD, GLEN ROCK, N.J. 07462	
JACK W. BARRETT, P.E., NO. 755	
DOB MA	DATE OF BIRTH
EMERGENCY STEAM	DRAWING CHG. CHNO.
LINE REPAIR	DATE OF NO.
	M-1
	PK. OF